



SPECIFICATION RW-2535

TE 108-121034

Pre-Print Push-On Cable Markers K-Type, Z-Type, V-Type and G-Type

SCOPE

This quality assurance specification establishes the quality standard for pre-printed cable markers for use as a general-purpose identification marker. The markers fall in to two categories PVC markers and Zero Halogen G-Type markers. All markers are available as alphanumeric characters or symbols and color coded in accordance with BS3858: 1992.

PVC markers, Z-Type, V-Type and K-Type, are fabricated from specially designed, extruded plasticized PVC profile. Markers are pre-marked using a thermal foil and then flame sealed to improve mark adherence and print permanence.

G-Type markers are fabricated from a Zero Halogen, low smoke and low toxic fume (LFH) compound. This allows the markers to be used where fire may pose a risk to human life.

Push-on markers are supplied as individual idents or partial cut continuous lengths. Z-Type, V-Type and G-Type have an expanding profile which allow markers to accommodate a wide range of wire/cable sizes.

Z-Type, V-Type and G-Type markers are designed to be installed pre-termination, K-type markers are designed to be applied once cabling has been connected. K-Type markers are designed to fit onto a PVC carrier, which is then attached to a substrate using cable ties.

Operating temperature range for markers: Z-Type, V-type and K-Type -40°C to 70°C (-40 to 158°F)
G-Type -45°C to 70°C (-49°F to 158°F)

THIS IS A CLASS 1 DOCUMENT WHICH IS NONCONFIDENTIAL.

The information contained within this document is the property of TE Connectivity. It is supplied in confidence and the commercial security of the contents must be maintained. It must not be used for any purpose other than that for which it is supplied nor may any information contained in it be disclosed to unauthorised persons. It must not be reproduced in whole or in part without obtaining written permission from TE Connectivity (TE).

While TE has made every reasonable effort to ensure the accuracy of the information in this standard, TE does not guarantee that it is error-free, nor does TE make any other representation, warranty or guarantee that the information is accurate, correct, reliable or current. TE reserves the right to make any adjustments to the information contained herein at any time without notice. TE expressly disclaims all implied warranties regarding the information contained herein, including, but not limited to, any implied warranties of merchantability or fitness for a particular purpose. The dimensions in this standard are for reference purposes only and are subject to change without notice. Specifications are subject to change without notice. Consult TE for the latest dimensions and design specifications.

*Trademark. TE Connectivity, TE connectivity (logo), and TE (logo) are trademarks. Other logos, product and/or company names may be trademarks of their respective owners.



Table of Contents

1 Revision History.....3

2 Requirements3

3 Quality assurance provisions.....8

4 Test Procedures8

5 Related standards 10

6 Test fluids 10

7 Sampling..... 11

8 Preparation for delivery 11

9 general requirements..... 12



1 REVISION HISTORY

| Revision Number | Description of change | Date | Incorporated By |
|-----------------|---|------------|-----------------|
| 1 | Initial release | Sept' 2013 | Lee Smith |
| 2 | Minor format changes | Jan' 2009 | Lee Smith |
| 3 | Removal of O-Type and addition of G-Type. | Nov' 2017 | Alan Kean |

2 REQUIREMENTS

2.1 Composition, Appearance and Color

Markers are manufactured from plasticized PVC or LFH materials. The markers shall be smooth and free from bubbles, pinholes, creases and other defects in appearance. Color shall be uniform, and be a reasonable match to the equivalent color given in BS 6746C.

Colors and Marking

| Color of Sleeve | Color code numerical association* | Color of mark G-Type | Color of mark Z-Type | Color of mark K-Type | Color of mark V-Type |
|-----------------|-----------------------------------|----------------------|----------------------|----------------------|----------------------|
| Black | 0 | | | | White |
| Brown | 1 | | | | White |
| Red | 2 | | | | White |
| Orange | 3 | | | | Black |
| Yellow | 4 | Black | Black | Black | Black |
| Green | 5 | | | | Black |
| Blue | 6 | | | | White |
| Violet | 7 | | | | White |
| Grey | 8 | | | | Black |
| White | 9 | | Black | | Black |

*IEC 60062 Marking codes for resistors and capacitors



Not Available

RW-2535




2.2 Dimensions
2.2.1 K-Type Markers

Supplied Dimensions

| Size code | Marker size | Wire size guide | | Dimension 'A' | | Dimension 'B' | | Nominal character height | Weight (g/250mm) |
|-----------|-------------|-----------------|-----|---------------|------|---------------|-------|--------------------------|------------------|
| | | min | max | min | max | min | max | | |
| 1361 | 65 | 4.2 | 7.0 | 2.90 | 3.20 | 9.90 | 10.20 | 4.0 | 10.1 |

Available in yellow (4) only. Supplied on a spool, partially cut for easy removal.

Figure 1: K-Type Marker Detail

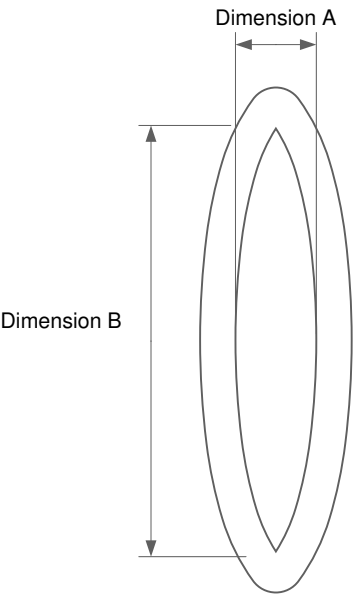


2.2.2 Z-Type Markers

Supplied Dimensions

| Size code (straight cut) | Size code chevron cut) | Marker size | Wire size guide (outside diameter) | | Marker length | Character height | Pack Size (pieces) |
|--------------------------------|------------------------------|----------------|---------------------------------------|------|------------------|---------------------|--------------------------|
| | | | min | max | | | |
| 0580 | 1151 | 5 | 1.5 | 2.0 | 4.3 | 1.8 | 1000 |
| 0581 | 1152 | 7 | 2.0 | 3.2 | 4.3 | 1.9 | 1000 |
| 0615 | 1153 | 9 | 2.5 | 4.0 | 4.3 | 2.6 | 1000 |
| 0616 | 1154 | 11 | 2.9 | 4.7 | 4.3 | 2.6 | 1000 |
| 0617 | 1155 | 13 | 3.4 | 5.7 | 4.3 | 2.7 | 1000 |
| 0618 | 1156 | 15 | 3.8 | 6.3 | 4.3 | 2.7 | 1000 |
| 0620 | 1157 | 18 | 4.3 | 6.9 | 4.3 | 2.7 | 500 |
| 0622 | 1158 | 23 | 5.5 | 8.9 | 6.0 | 3.5 | 500 |
| 0624 | 1159 | 35 | 7.9 | 12.7 | 6.0 | 3.5 | 250 |

Dimensions in mm

Figure 2: Z-Type Marker Detail

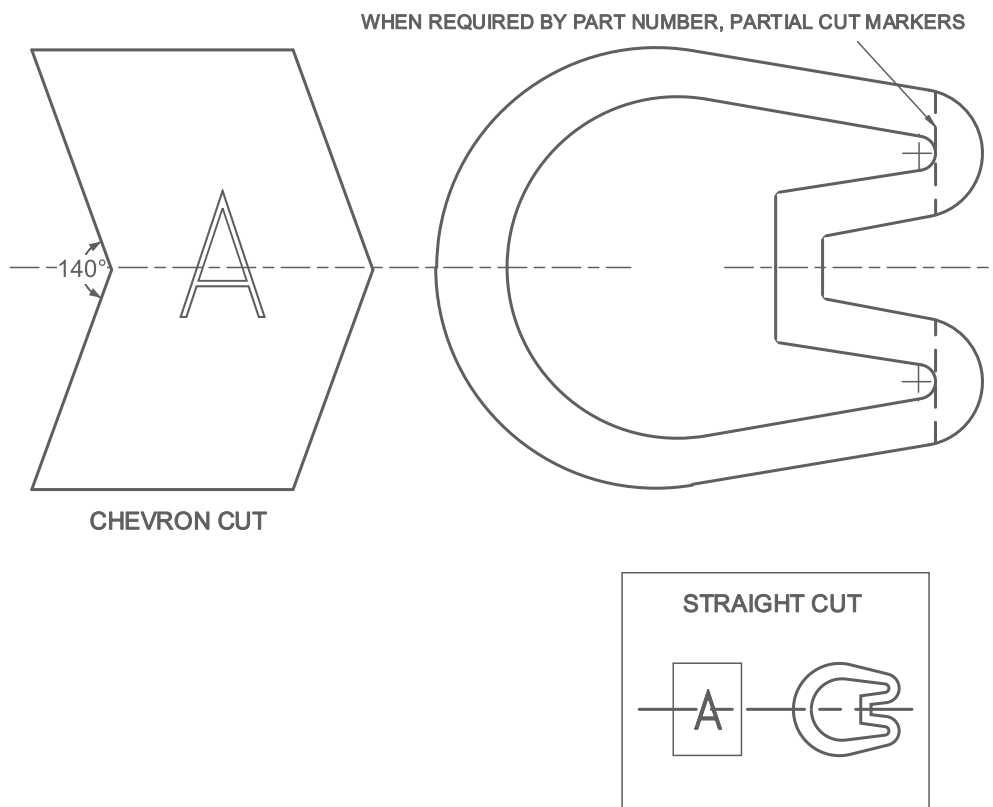




2.2.3 V-Type Markers

Supplied Dimensions

| Size code | Marker size | Wire size guide (outside diameter) | | Marker length | Character height | Pack Size (pieces) |
|-----------|-------------|------------------------------------|------|---------------|------------------|--------------------|
| | | min | max | | | |
| 0761 | 3/3 | 1.4 | 2.8 | 2.9 | 3.0 | 1000 |
| 0762 | 5/3 | 2.8 | 5.0 | 2.9 | 3.0 | 1000 |
| 0763 | 10/4 | 4.0 | 10.0 | 3.9 | 4.0 | 500 |
| 0764 | 16/6 | 8.0 | 16.0 | 5.9 | 4.0 | 250 |

Dimensions in mm

Figure 3: V-Type Marker Detail – Chevron cut only

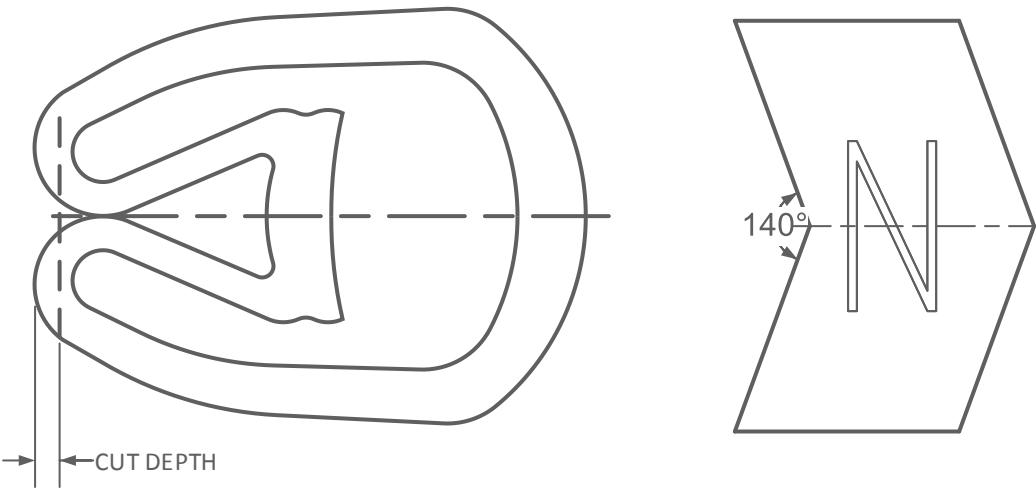




2.2.4 G-Type Markers

Supplied Dimensions

| Size code | Marker size | Wire size guide (outside diameter) | | Marker length | Character height | Pack size (pieces) |
|-----------|-------------|------------------------------------|------|---------------|------------------|--------------------|
| | | min | max | | | |
| 0719 | G3/10 | 1.4 | 2.5 | 4.5 | 2.4 | 1000 |
| 0720 | G3/20 | 2.8 | 3.5 | 4.5 | 2.4 | 1000 |
| 0721 | G4/10 | 3.0 | 6.0 | 6.0 | 3.2 | 500 |
| 0722 | G6/10 | 5.0 | 9.5 | 6.0 | 4.0 | 250 |
| 0723 | G6/20 | 8.0 | 12.5 | 6.0 | 4.0 | 250 |

Dimensions in mm

Figure 4: G-Type Marker Detail – Chevron cut only

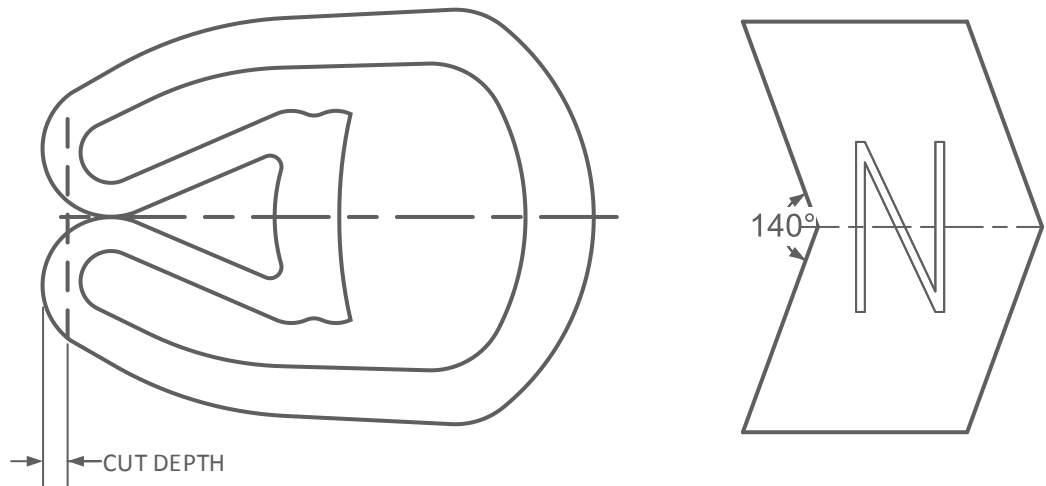

2.3 Printing

Markers are printed using hot foil marking with a single character or a legend. The mark is black or white as required. Where there is possibility of misinterpretation the character shall be followed by a period in the lower right of the mark. Mark density shall be at a level that enables the reader to clearly recognise the character at 355mm (14 inch).



2.4 Properties

The markers shall meet the requirements detailed below in the general requirements table

3 QUALITY ASSURANCE PROVISIONS

3.1 Qualification Tests

Qualification tests are those performed on finished markers, submitted for qualification as a satisfactory product and shall consist of all tests listed in this specification.

For K-Type markers one size and color shall qualify the whole range. A minimum of two sizes and one color of other markers shall be considered to cover the full range.

4 TEST PROCEDURES

4.1 Preparation of Test Specimens

Unless specified, markers shall be tested as supplied. All tests shall be made at a temperature of $23 \pm 2^{\circ}\text{C}$.

When required by the test procedure, three markers shall be used for each test.

For ease of testing markers shall be slid onto metal mandrels before testing. Mandrel sizes will be based on the maximum cable diameter as recommended by TE Connectivity, see product dimensions in section 2.

4.2 Print Performance

4.2.1 Mark Adherence

Three sets of markers shall be tested for each marker type and size; a set is a minimum of 5 markers. Markers shall be mounted onto metal mandrels as given in section 4.1, and then tested in accordance with TE test procedure 109-121012, using the 'Eraser Preparation for Mark Adherence testing' set up. Samples shall be rubbed 20 times using a modified Crockmeter fitted with an eraser and a 1kg load.

The marking shall be examined for legibility using normal reading vision. Print contrast shall be measured in accordance with TE Document 411-121002.



4.2.2 Fluid Resistance

For each fluid, three sample sets of markers shall be immersed. A set is a minimum of 5 markers, mounted onto metal mandrels as detailed in section 4.1. Completely immerse the markers for the times and at the temperatures specified in the general requirements given in section 9. The volume of the fluid shall be not less than 20 times that of the specimen.

After immersion, lightly blot the markers with tissue paper to remove excess surface fluid and suspend the samples to air dry for at least 2 hours prior to rub testing.

The marking shall be tested in accordance with TE test reference 109-121012. Samples are tested with a Crockmeter fitted with 'Super Twill' cloth and a 1kg load.

After the print permanence test, marking shall be examined for legibility using normal reading vision. Print contrast shall be measured in accordance with TE Document 411-121002.

4.3 Environmental Testing

Markers shall be prepared as given in section 4.1.

Suspend vertically in an air circulating oven at 70°C for 168 hours. The samples are then transferred immediately to a cold chamber maintained at -40°C for 1 hour.

At the end of the conditioning period, check for signs of splitting, blistering or cracking. Samples shall be stored at 23°C for 4 hours.

Test samples in accordance with TE test procedure 109-121012, using the 'Eraser Preparation for Mark Adherence testing' set up. Samples shall be rubbed 20 times using a Crockmeter fitted with an eraser and a 1kg load.

The marking shall be examined for legibility using normal reading vision. Print contrast shall be measured in accordance with TE Document 411-121002.



5 RELATED STANDARDS

| REFERENCE | TITLE | COMPLIES WITH |
|-------------|---|----------------|
| 411-121002 | TE Connectivity print contrast reference scale | NOT APPLICABLE |
| 109-121012 | TE Connectivity Work Instruction - Print permanence testing using the mechanical Crockmeter | SAE AS5942 |
| SAE AS 5942 | Society of Automotive Engineers standard for Marking of Electrical Insulation Sleeves. | NOT APPLICABLE |

6 TEST FLUIDS

| Fluid | Description |
|---|--|
| Aircraft fuel | JP 8 Kerosene based Jet fuel |
| MIL-PRF-23699 | Synthetic lubricating oil STD class (NATO Code 0-156). Has replaced MIL-L-7808 oil at temperatures above 25°C. |
| MIL-H-83282 | The principal hydraulic fluid used in military aircraft. It replaces MIL-H-5606. |
| Diesel Fuel (BS EN 590:2009 A1) | General automotive fuel |
| Propylene Glycol de-icing fluid (SAE-AMS-1424) | 50/50% (v/v) mixture with water |
| Tap Water | Universal solvent |
| Sea Water | Artificial sea water solution |
| Sodium chloride solution | 5% (mass/mass in water) standard salt solution |
| Teepol | 1% Teepol in water (v/v) - commonly used detergent |
| IPA - Isopropyl alcohol | Widely used as a solvent and cleaner |
| Skydrol LD4 | Common aircraft hydraulic fluid. (G-Type only) |



7 SAMPLING

Testing frequency shall be Production routine or Qualification. Production routine tests shall be carried out on every manufactured batch and shall consist of visual examination for workmanship, printing quality and dimensions.

A manufactured batch is defined as that quantity of material extruded at any one time from the same compound batch.

Qualification shall be carried out to the requirements of the Design Authority.

8 PREPARATION FOR DELIVERY

8.1 Packaging

Markers shall be supplied on spools or in boxes. Each package shall be labelled showing the description, quantity, size, batch number and date of manufacture.

Additional information may be supplied as specified in the contract or order.



9 GENERAL REQUIREMENTS

| TEST | RW-2535 REF. | UNITS | TEST REQUIREMENTS |
|---|--|-------|---|
| PHYSICAL | | | |
| Composition, appearance and color | Section 2.1. | --- | Markers shall be smooth and free from bubbles, pinholes and creases and other defects in appearance. Color shall be uniform, and be a reasonable match to the equivalent color given in BS 6746C. |
| Dimensions | Section 2.2. | mm | Figures 1 to 4. |
| PRINT PERFORMANCE | | | |
| Print Quality | Section 2.3 | --- | Initial Print Contrast C8 minimum. |
| Mark Adherence | Section 4.2.1. TE Test Method 109-121012 | --- | Print shall remain legible, minimum Print Contrast C3. |
| Fluid Resistance <ul style="list-style-type: none"> ✦ Aircraft Fuel (JP-8) ✦ MIL-PRF-23699 ✦ MIL-H-83282 ✦ Diesel Fuel ✦ Propylene Glycol ✦ Tap Water ✦ Sea Water ✦ Sodium Chloride (5% solution) ✦ Teepol Detergent ✦ Isopropyl alcohol ✦ Skydrol LL4D¹ | Section 4.2.2. 24 hours at 23°C, followed by 2 hours' air drying at room temperature. 20 rubs using TE Test method 109-121012, Crockmeter, Super Twill, 1kg load. | --- | No color change, no splitting, swelling or cracking. Print shall remain legible, minimum Print Contrast C3. ¹ G-Type marker only. |
| ENVIRONMENTAL TESTING | | | |
| Resistance to Extremes of Temperature | Section 4.3. | --- | No splitting, cracking or blistering. The original color shall be identifiable. Print shall remain legible, minimum Print Contrast C3. |

TE (Logo) is a trademark Other logos, product and company names mentioned herein may be trademarks of their respective owners.



Компания «ЭлектроПласт» предлагает заключение долгосрочных отношений при поставках импортных электронных компонентов на взаимовыгодных условиях!

Наши преимущества:

- Оперативные поставки широкого спектра электронных компонентов отечественного и импортного производства напрямую от производителей и с крупнейших мировых складов;
- Поставка более 17-ти миллионов наименований электронных компонентов;
- Поставка сложных, дефицитных, либо снятых с производства позиций;
- Оперативные сроки поставки под заказ (от 5 рабочих дней);
- Экспресс доставка в любую точку России;
- Техническая поддержка проекта, помощь в подборе аналогов, поставка прототипов;
- Система менеджмента качества сертифицирована по Международному стандарту ISO 9001;
- Лицензия ФСБ на осуществление работ с использованием сведений, составляющих государственную тайну;
- Поставка специализированных компонентов (Xilinx, Altera, Analog Devices, Intersil, Interpoint, Microsemi, Aeroflex, Peregrine, Syfer, Eurofarad, Texas Instrument, Miteq, Cobham, E2V, MA-COM, Hittite, Mini-Circuits, General Dynamics и др.);

Помимо этого, одним из направлений компании «ЭлектроПласт» является направление «Источники питания». Мы предлагаем Вам помощь Конструкторского отдела:

- Подбор оптимального решения, техническое обоснование при выборе компонента;
- Подбор аналогов;
- Консультации по применению компонента;
- Поставка образцов и прототипов;
- Техническая поддержка проекта;
- Защита от снятия компонента с производства.



Как с нами связаться

Телефон: 8 (812) 309 58 32 (многоканальный)

Факс: 8 (812) 320-02-42

Электронная почта: org@eplast1.ru

Адрес: 198099, г. Санкт-Петербург, ул. Калинина, дом 2, корпус 4, литера А.