

BIDIRECTIONAL THYRISTOR OVERVOLTAGE PROTECTORS



TISP4xxxL3BJ Overvoltage Protector Series

MODEM Protection against:

- TIA/EIA-IS-968 Type A & B surge (formally FCC Part 68)
- UL 60950, Clause 6. power cross
- CSA 22.2 No. 60950, Clause 6. power cross

Ring-Tip ProtectionTISP4350L3BJ

Electronics Protection.....TISP4070L3BJ


Ion-Implanted Breakdown Region
Precise and Stable Voltage
Low Voltage Overshoot under Surge

Device	V_{DRM} V	$V_{(BO)}$ V
'4070	58	70
'4350	275	350

Rated for '60950 and '968 Wave Shapes

Surge Type	Standard	Wave Shape	I_{TSP} A
A	TIA/EIA-IS-968 (FCC Part 68)	10/160 μ s	50
		10/560 μ s	30
B	TIA/EIA-IS-968 (FCC Part 68) UL 60950 / ITU-T K.21	9/720 μ s 10/700 μ s	40

SMBJ Package (Top View)

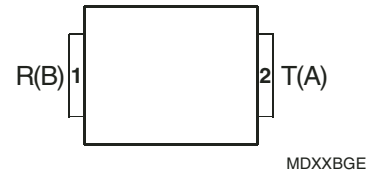

Device Symbol



Terminals T and R correspond to the alternative line designators of A and B

 UL Recognized Components

Description

These devices are designed to limit overvoltages on the telephone line. Overvoltages are normally caused by a.c. power system or lightning flash disturbances which are induced or conducted on to the telephone line. A single device provides 2-point protection and is typically used for the protection of 2-wire telecommunication equipment (e.g. between the Ring and Tip wires for telephones and modems). Combinations of devices can be used for multi-point protection (e.g. 3-point protection between Ring, Tip and Ground).

The protector consists of a symmetrical voltage-triggered bidirectional thyristor. Overvoltages are initially clipped by breakdown clamping until the voltage rises to the breakover level, which causes the device to crowbar into a low-voltage on state. This low-voltage on state causes the current resulting from the overvoltage to be safely diverted through the device. The high crowbar holding current prevents d.c. latchup as the diverted current subsides. These protectors are guaranteed to voltage limit and withstand the listed lightning surges in both polarities.

After a Type A surge the equipment can be non-operational or operational. An operational pass requires the two high current Type A surges (200 A, 10/160, and 100A, 10/560), to be reduced to within the TISP4xxxL3BJ ratings (50 A, 10/160 and 30 A, 10/560).

How To Order

Device	Package	Carrier	Order As
TISP4xxxL3BJ	BJ (J-Bend DO-214AA/SMB)	Embossed Tape Reeled	TISP4xxxL3BJR-S

Insert xxx value corresponding to protection voltages of 070 and 350

After a Type B surge, the equipment must be operational. As the TISP4xxxL3BJ has a current rating of 40 A, it will survive both Type B surges, metallic (25 A, 9/720) and longitudinal (37.5 A, 9/720), giving an operational pass to Type B surges.

TISP4xxxL3BJ Overvoltage Protector Series

BOURNS®

Description (continued)

For metallic protection, the TISP4350L3BJ is connected between the Ring and Tip conductors. For longitudinal protection, two TISP4350L3BJ protectors are used; one between the Ring conductor to ground and the other between the Tip conductor to ground. The B type ringer has voltages of 56.5 V d.c. and up to 150 V r.m.s. a.c., giving a peak voltage of 269 V. The TISP4350L3BJ will not clip the B type ringing voltage as it has a high impedance up to 275 V.

The TISP4070L3BJ should be connected after the hook switch to protect the following electronics. As the TISP4070L3BJ has a high impedance up to 58 V, it will switch off after a surge and not be triggered by the normal exchange battery voltage.

These low (L) current protection devices are in a plastic package SMBJ (JEDEC DO-214AA with J-bend leads) and supplied in embossed tape reel pack. For alternative voltage and holding current values, consult the factory. For higher rated impulse currents in the SMB package, the 100 A 10/1000 TISP4xxxH3BJ series is available.

Absolute Maximum Ratings, $T_A = 25^\circ\text{C}$ (Unless Otherwise Noted)

Rating	Symbol	Value	Unit
Repetitive peak off-state voltage '4070 '4350	V_{DRM}	± 58 ± 275	V
Non-repetitive peak on-state pulse current (see Notes 1, and 2) 10/160 μs (FCC Part 68, 10/160 μs voltage wave shape, Type A) 5/310 μs (ITU-T K.21, 10/700 μs voltage wave shape) 5/320 μs (FCC Part 68, 9/720 μs voltage wave shape, Type B) 10/560 μs (FCC Part 68, 10/560 μs voltage wave shape, Type A)	I_{TSP}	50 40 40 30	A
Non-repetitive peak on-state current (see Notes 1, 2 and 3) 20 ms (50 Hz) full sine wave 16.7 ms (60 Hz) full sine wave 1000 s 50 Hz/60 Hz a.c.	I_{TSM}	12 13 2	A
Initial rate of rise of on-state current, Exponential current ramp, Maximum ramp value < 100 A	di_{T}/dt	120	A/ μs
Junction temperature	T_{J}	-40 to +150	$^\circ\text{C}$
Storage temperature range	T_{stg}	-65 to +150	$^\circ\text{C}$

- NOTES: 1. Initially the TISP4xxxL3BJ must be in thermal equilibrium with $T_{\text{J}} = 25^\circ\text{C}$.
2. The surge may be repeated after the TISP4xxxL3BJ returns to its initial conditions.
3. EIA/JESD51-2 environment and EIA/JESD51-3 PCB with standard footprint dimensions connected with 5 A rated printed wiring track widths. Derate current values at $-0.61\% / ^\circ\text{C}$ for ambient temperatures above 25°C .

Overload Ratings, $T_A = 25^\circ\text{C}$ (Unless Otherwise Noted)

Rating	Symbol	Value	Unit
Peak overload on-state current, Type A impulse (see Note 4) 10/160 μs 10/560 μs	$I_{\text{T(OV)M}}$	200 100	A
Peak overload on-state current, a.c. power cross tests UL 1950 (see Note 4)	$I_{\text{T(OV)M}}$	See Figure 2 for current versus time	A

- NOTE 4: These electrical stress levels may damage the TIS4xxxL3BJ silicon chip. After test, the pass criterion is either that the device is functional or, if it is faulty, that it has a short circuit fault mode. In the short circuit fault mode, the following equipment is protected as the device is a permanent short across the line. The equipment would be unprotected if an open circuit fault mode developed.

TISP4xxxL3BJ Overvoltage Protector Series

BOURNS®

Electrical Characteristics for the R and T Terminals, $T_A = 25\text{ }^{\circ}\text{C}$ (Unless Otherwise Noted)

Parameter	Test Conditions	Min	Typ	Max	Unit
I_{DRM} Repetitive peak off-state current	$V_D = V_{\text{DRM}}$ $T_A = 25\text{ }^{\circ}\text{C}$ $T_A = 85\text{ }^{\circ}\text{C}$			± 5 ± 10	μA
$V_{(\text{BO})}$ Breakover voltage	$dv/dt = \pm 250\text{ V/ms}$, $R_{\text{SOURCE}} = 300\text{ }\Omega$ '4070 '4350			± 70 ± 350	V
$V_{(\text{BO})}$ Impulse breakover voltage	$dv/dt \leq \pm 1000\text{ V}/\mu\text{s}$, Linear voltage ramp, Maximum ramp value = $\pm 500\text{ V}$ $di/dt = \pm 20\text{ A}/\mu\text{s}$, Linear current ramp, Maximum ramp value = $\pm 10\text{ A}$ '4070 '4350			± 78 ± 359	V
$I_{(\text{BO})}$ Breakover current	$dv/dt = \pm 250\text{ V/ms}$, $R_{\text{SOURCE}} = 300\text{ }\Omega$	± 40		± 250	mA
V_T On-state voltage	$I_T = \pm 5\text{ A}$, $t_W = 100\text{ }\mu\text{s}$			± 3	V
I_H Holding current	$I_T = \pm 5\text{ A}$, $di/dt = -/+ 30\text{ mA/ms}$	± 120		± 350	mA
dv/dt Critical rate of rise of off-state voltage	Linear voltage ramp, Maximum ramp value $< 0.85V_{\text{DRM}}$	± 5			kV/ μs
I_D Off-state current	$V_D = \pm 50\text{ V}$ $T_A = 85\text{ }^{\circ}\text{C}$			± 10	μA
C_{off} Off-state capacitance	$f = 100\text{ kHz}$, $V_d = 1\text{ V rms}$, $V_D = 0$ $V_D = 1\text{ V}$ $V_D = 5\text{ V}$ $f = 100\text{ kHz}$, $V_d = 1\text{ V rms}$, $V_D = 0$ $V_D = 1\text{ V}$ $V_D = 5\text{ V}$ '4070 '4350		40 38 31 26 24 20	50 48 39 33 30 25	pF

Thermal Characteristics

Parameter	Test Conditions	Min	Typ	Max	Unit
$R_{\theta\text{JA}}$ Junction to free air thermal resistance	EIA/JESD51-3 PCB, $I_T = I_{\text{TSM}(1000)}$, $T_A = 25\text{ }^{\circ}\text{C}$, (see Note 5)			115	$^{\circ}\text{C}/\text{W}$
	265 mm x 210 mm populated line card, 4-layer PCB, $I_T = I_{\text{TSM}(1000)}$, $T_A = 25\text{ }^{\circ}\text{C}$		52		

NOTE 5: EIA/JESD51-2 environment and PCB has standard footprint dimensions connected with 5 A rated printed wiring track widths.

Parameter Measurement Information

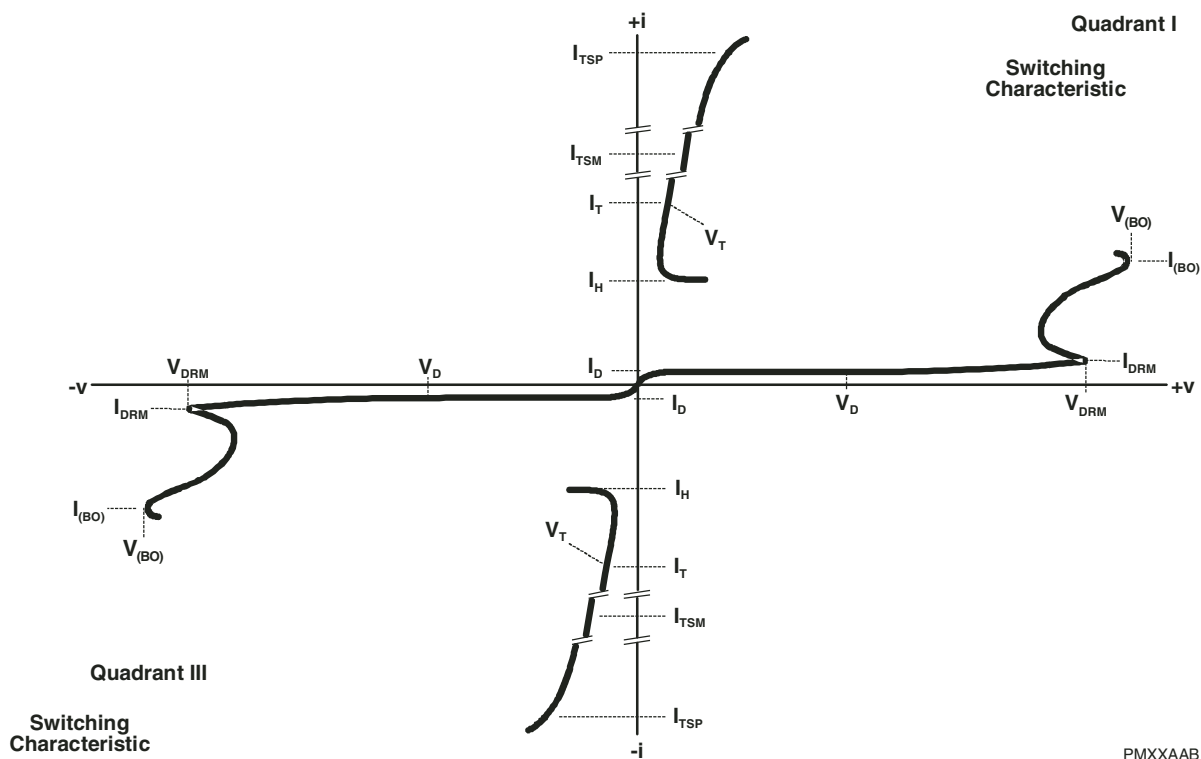


Figure 1. Voltage-current Characteristic for T and R Terminals
All Measurements are Referenced to the R Terminal

Thermal Information

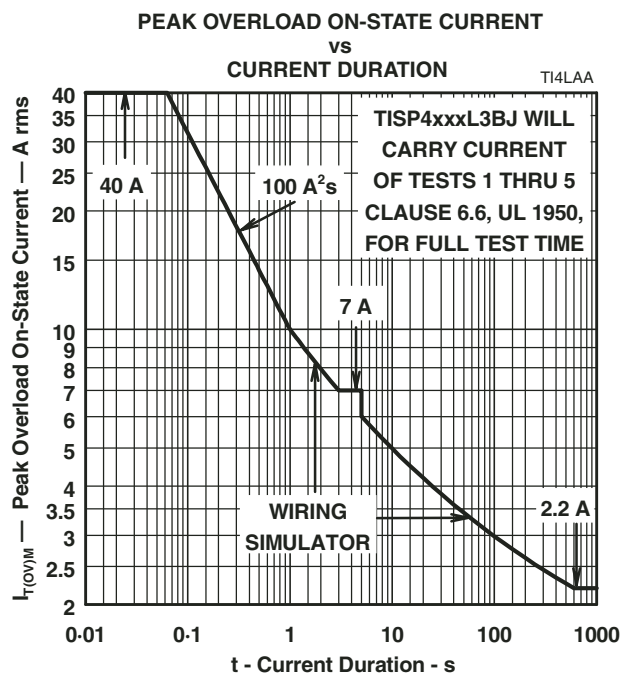


Figure 2. Peak Overload On-state Current against Duration

TISP4xxxL3BJ Overvoltage Protector Series

BOURNS®

APPLICATIONS INFORMATION

FCC Part 68, ACTA, TIA and EIA

From 2001, the registrations for FCC equipment changed from the FCC to ACTA, Administrative Council for Terminal Attachments. For this function, ACTA needed to adopt a US National standard specifying terminal equipment requirements. The TIA, Telecommunications Industry Association, in conjunction with the EIA, Electronic Industries Alliance, created TIA/EIA-IS-968 for this purpose. The first issue of TIA/EIA-IS-968 is essentially a renumbered version of the FCC Part 68 requirement. Clause and figure changes are shown in the table.

Item	FCC Part 68	TIA/EIA-IS-968
Telephone Line Surge – Type A	Clause 68.302 (b)	Clause 4.2.2
Telephone Line Surge – Type B	Clause 68.302 (c)	Clause 4.2.3
Simplified Surge Generator	Fig. 68.302 (a)	Figure 4.1
Open Circuit voltage Wave shape	Fig. 68.302 (b)	Figure 4.2
Short Circuit Current Wave shape	Fig. 68.302 (c)	Figure 4.3

TIA/EIA-IS-968 (FCC Part 68) Impulse Testing

To verify the withstand capability and safety of the equipment, standards require that the equipment is tested with various impulse wave forms. The table below shows values for the TIA/EIA-IS-968 and ITU-T recommendation K.21.

Standard	Test Condition V	Peak Voltage V	Voltage Wave Form µs	Peak Current A	Current Wave Form µs	Fictive Impedance Ω	TISP4xxxL3 Rating A	Series Resistance Ω
TIA/EIA-IS-968 (FCC Part 68)	Longitudinal	1500	10/160	200	10/160	7.5	50	2 x 24
	Metallic	800	10/560	100	10/560	8	30	19
	Longitudinal	1500	9/720 †	37.5	5/320 †	40	40	0
	Metallic	1000	9/720 †	25	5/320 †	40	40	0
ITU-T K.21 ‡ Basic Level	Transverse	1500 4000	10/700	37.5 100	5/310	40	30	0 10
ITU-T K.21 ‡ Enhanced Level	Transverse	1500 6000	10/700	37.5 125	5/310	40	30	0 10

† TIA/EIA-IS-968 terminology for the wave forms produced by the ITU-T recommendation K.21 10/700 impulse generator

‡ Values assume the TISP4xxxL3 is connected inter-conductor and a 400 V primary is used

If the impulse generator current exceeds the protector's current rating then a series resistance can be used to reduce the current to the protector's rated value to prevent possible failure. The required value of series resistance for a given wave form is given by the following calculations. First, the minimum total circuit impedance is found by dividing the impulse generator's peak voltage by the protector's rated current. The impulse generator's fictive impedance (generator's peak voltage divided by peak short circuit current) is then subtracted from the minimum total circuit impedance to give the required value of series resistance.

For the TIA/EIA-IS-968 10/560 wave form the following values result. The minimum total circuit impedance is $800/30 = 26.7 \Omega$ and the generator's fictive impedance is $800/100 = 8 \Omega$. For an inter-conductor connected TISP4xxxL3, this gives a minimum series resistance value of $26.7 - 8 = 18.7 \Omega$. After allowing for tolerance, a $20 \Omega \pm 5 \%$ resistor would be suitable. The 10/160 wave form only needs to be considered if the TISP4350L3 is connected from the conductor to ground. In this case, the conductor series resistance is $24 \Omega \pm 5 \%$ per conductor.

IEC 60950, UL 1950/60950, CSA C22.2 No. 950/60950 and EN 60950

These electrical safety standards for IT (Information Technology) equipment at the customer premise use the IEC (International Electrotechnical Commission) 60950 standard as the core document. The IEC 60950 covers fundamental safety criteria such as creepage and isolation. The connection to a telecommunication network voltage (TNV) is covered in clause 6.

Europe is harmonized by CENELEC (Comité Européen de Normalization Electro-technique) under EN 60950 (included in the Low Voltage Directive, CE mark). Up to the end of 2000, the US had UL (Underwriters Laboratories) 1950 and Canada CSA (Canadian Standards Authority) C22.2 No. 950. The US and Canadian standards include regional changes and additions to the IEC 60950. A major addition is the inclusion of clause 6.6, power cross withstand containing the flowchart Figure 18b and annex NAC covering testing. Remarks made for UL 1950 will generally be true for CSA 22.2 No. 950.

AUGUST 1999 - REVISED JANUARY 2007

Specifications are subject to change without notice.

Customers should verify actual device performance in their specific applications.

APPLICATIONS INFORMATION**IEC 60950, UL 1950/60950, CSA C22.2 No. 950/60950 and EN 60950 (continued)**


In December 2000, UL released UL 60950, which will run concurrently with UL 1950 until 2003, after which submittals can only be made for UL 60950. The equivalent Canadian document is designated CSA C22.2 No. 60950. Changes and differences between UL 1950 and UL 60950 do not affect power cross testing nor evaluation criteria. Clause and figure numbering has changed between the standards and these changes are shown in the table. In this document, these two standards are being jointly referred to as UL 60950 and the clause and figure numbering referenced will be from UL 60950.

Item	UL 1950	UL 60950
Protection against overvoltage from power line crosses	Clause 6.6	Clause 6.4
Overvoltage flowchart	Figure 18b	Figure 6C

UL 60950, Clause 6.4 – Power Cross

Figure 3 shows the criterion flow for UL 60950 power cross. (This is a modified version of UL6050, Figure 6C — Overvoltage flowchart). There are many routes for achieving a pass result. For discussion, each criterion has been given a letter reference. Brief details of any electrical testing is given as a criterion note. Test pass criteria are given in the bottom table of Figure 3.

APPLICATIONS INFORMATION

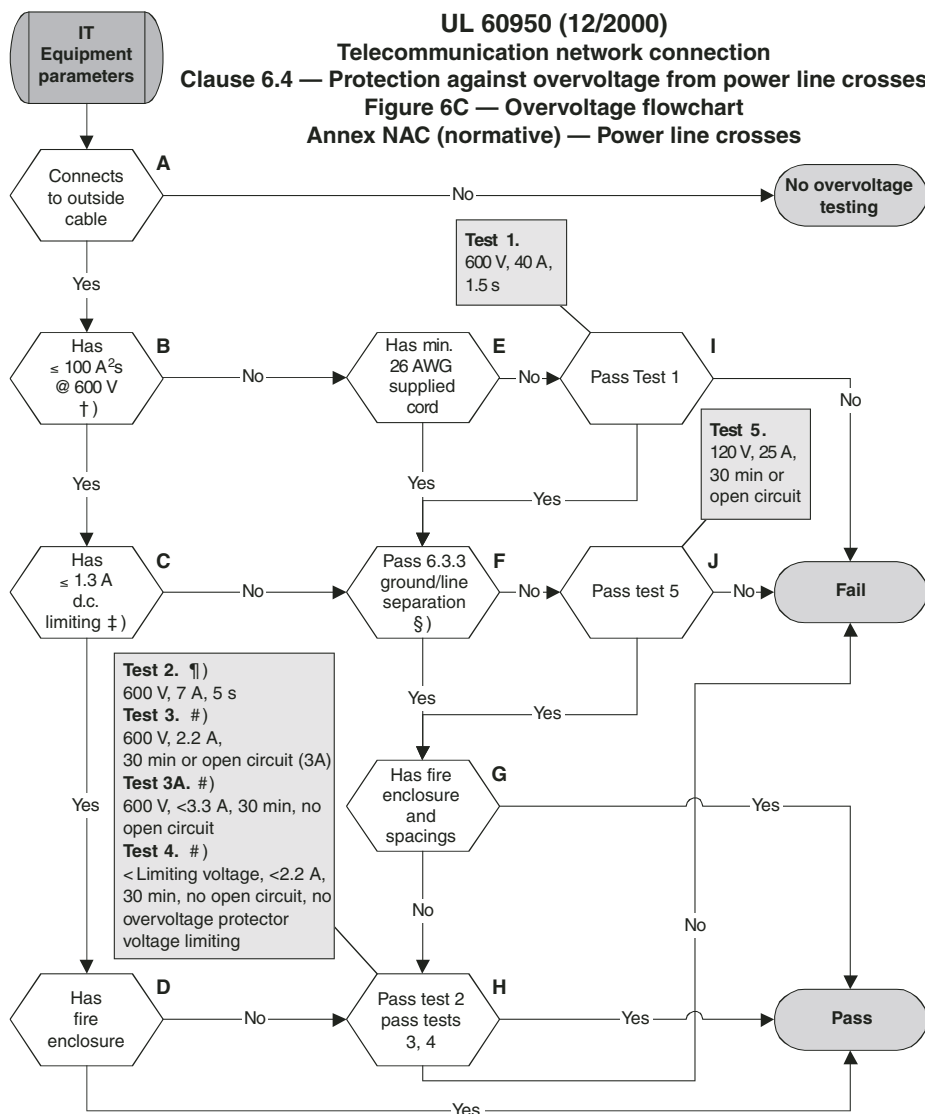

NOTES

†) Overcurrent protector I^2t must be lower than any other equipment element which carries the same current.

‡) UL accepts that a fuse with a 1 A or less rating meets the 1.3 A criterion.

§) Pass for 120 V a.c. between telecommunication line and ground current < 10 mA.

¶) Test 2 not required if the equipment d.c. breaking is 1.3 A or less, see comment ‡).

#) Tests 3 and 4 not required for equipment with less than 1000 m of outside cable.

Pass criteria	Test 1	Test 2	Test 3	Test 3A	Test 4	Test 5
No cheesecloth charring	✓	✓	✓	✓	✓	✓
Insulation OK	✓	✓	✓	✓	✓	✓
Wiring simulator (fuse) OK	✓					✓
$I^2t < 100 \text{ A}^2\text{s} @ 600 \text{ V a.c.}$	✓					

Users must verify requirements against latest issue of UL 60950

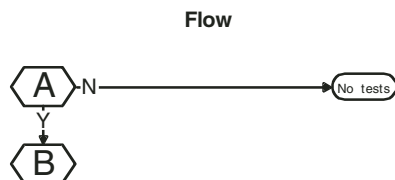
AIUL60950A

Figure 3. UL 60950 Power Cross Flow Chart

APPLICATIONS INFORMATION


Power Cross Pass Routes

This discussion covers typical modem flows.

**Box A****Comment**


The criterion for box A is if the modem connects to an outside TNV line.

The majority of modems will be connected to an outside line, so the answer is yes. The yes path goes to box B.

**Box B**

The criterion for box B is if the equipment has a limit of $\leq 100 \text{ A}^2\text{s}$ at 600 V rms for Test 1. Many interpret this as a fuse with $I^2t \leq 100 \text{ A}^2\text{s}$ and often miss the 600 V a.c. breaking requirement. However, the current loop is completed by the fuse and other equipment components. To ensure that the fuse I^2t sets the equipment performance, the other current loop components, such as the printed wiring (PW), must have higher I^2t values than the fuse. Certainly the fuse I^2t needs to be lower than $100 \text{ A}^2\text{s}$ but other components, for example IC packaging, may impose a hazard-free limit of $10 \text{ A}^2\text{s}$. (This conflicts with TIA/EIA-IS-968 Type A surge pass requirement of $8 \text{ A}^2\text{s}$.)

A yes leads to box C and a no to box E.

**Boxes E and I**

The criterion for box E is for a minimum telecommunications line cord of No. 26 AWG to be supplied or specified.

A yes leads to box F and a no to box I.

The criterion for box I is to pass Test 1.


If all the four pass criteria of Test 1 are met, this is a yes and the flow goes to box F.

A no result fails the equipment.

APPLICATIONS INFORMATION

Power Cross Pass Routes (continued)

Flow

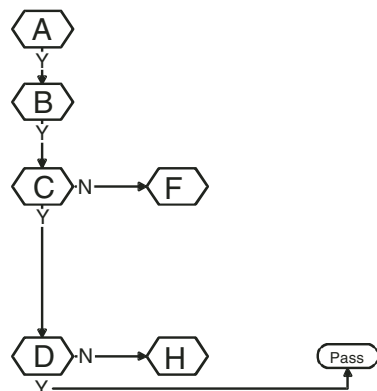

Comment

Boxes C and D


The criterion for box C is overcurrent protection that reduces currents above 1.3 A. This requirement is met by a 1 A fuse (a 1 A current fusing rating, not an IEC 1 A current carrying rating).

Modems which pass FCC Part 68 Type B surges and non-operationally pass Type A surges can use a fuse of 1 A or less, so the *yes* path to box D can be followed. High performance modems which operationally pass both Type A and B surges would need a fuse of greater than 1 A and so follow the *no* path to box F.

The criterion for box D is a fire enclosure.

Few modems can afford fire enclosures. However, for an internal modem in a known computer case, the case may be evaluated as a fire enclosure. A successful case evaluation will give a *yes* and an equipment pass.

More likely, the modem will not have a fire enclosure. The *no* flow goes to box H.



Boxes F and J


The criterion for box F is a pass to clause 6.3.3 requirements.

A *yes* goes to box G and a *no* goes to box J.

The criterion for box J is to pass Test 5.

If all the three pass criteria of Test 5 are met, this is a *yes* and the flow goes to box G.

A *no* result fails the equipment.



Boxes G and H

The criterion for box G is a fire enclosure and spacings (See box D comments).

A *yes* result passes the equipment and a *no* result leads to box H.

The criterion for box H is to pass Tests 2, 3 and 4. Test 2 is not required if there is overcurrent protection that reduces currents above 1.3 A (See box C).

High performance modems, using fuses and without fire enclosures, must pass tests 2, 3, possibly 3A if the fuse opens, and 4. For standard modems, using fuses of 1 A or less and without fire enclosures, tests 3, 3A and 4 must be passed.

If the two pass criteria of each of the tests performed are met, this is a *yes* and the equipment passes.

A *no* result fails the equipment.

APPLICATIONS INFORMATION

TISP4xxxL3BJ and UL 60950 Power Cross

The TISP4xxxL3BJ conducts current for periods greater than the power cross test times, Figure 2, so the TISP4xxxL3BJ is not a major factor in UL 60950 compliance. The main design task for UL 60950 power cross is about enclosure design and the selection of the other components that are subject to power cross. A UL specified fuse together with a TISP4xxxL3BJ gives a simple approach to meeting the power cross requirements.

Fuse Values

There are two areas of fuse criteria; surge capability (TIA/EIA-IS-968 (FCC Part 68) impulse) and power cross capability (UL60950 clause 6.4 and annex NAC).

To survive an impulse, a fuse must have a melting I^2t rating greater than the impulse I^2t . The fuse I^2t rating should be specified for the impulse waveshape current as the normal d.c. rating may not result in adiabatic conditions. Alternatively, the fuse may be specified for a rated current under the impulse waveshape conditions.

An exponentially decaying impulse with a current amplitude I_{PP} and 50 % amplitude decay time of t_D has an I^2t value of $0.72 I_{PP}^2 t_D$. Test waveforms have tolerances and the formula can be approximated to $I_{PP}^2 t_D$, giving about a 40 % allowance to cover tolerances, e.g. +5 % on I_{PP} and +30 % on t_D . Using the approximate formula, the I^2t values for typical waveforms are shown in the table below.

Specification	Amplitude I_{PP} A	Current Wave Shape t_R / t_D (μs)	Melting I^2t A^2s
TIA/EIA-IS-968 Type A (FCC Part 68)	200	10/160	6.4
	100	10/560	5.6
TIA/EIA-IS-968 Type B (FCC Part 68)	37.5	5/320	0.45
UL 60950 / ITU-T K.21	37.5	5/310	0.45
Telcordia (formally Bellcore) GR-1089-CORE	500	2/10	2.5
	100	10/1000	10
UL 60950, Annex NAC testing requires that the total I^2t does not exceed 100 A^2s for test 1 K.21 has a.c. induction withstand tests of 1 A^2s (basic) and 10 A^2s (enhanced)			

Fuse power cross current capability can be determined from its time-current curve. The fuse must be rated to break the current at the applied power cross a.c. voltage level.

Fuses for TIA/EIA-IS-968

To survive both the Type A surges, a fuse I^2t value of greater than 6.4 A^2s is needed. Fuses such as the Bel SMP 1.25 will meet this criteria and they are rated for 60 A, 600 V a.c. interruption.

Fuses must not operate on the Type B surge. To survive a 37.5 A Type B surge, the fuse needs to have an I^2t of greater than 0.45 A^2s . A non-operational pass for TIA/EIA-IS-968 Type A impulses is allowed; this could be a design approach with the TISP4xxxL3, which is likely to fail short with Type A impulses. A fuse with an I^2t greater than 0.45 A^2s and less than 5.6 A^2s would be needed to ensure that the resultant Type A impulse fault mode disconnects the modem from the line (avoiding a permanent off-hook condition). The Bel SMP 500 fuse starts to operate at 60 % of the specified Type A impulse current levels and is rated for 60 A, 600 V a.c. interruption.

Fuses for ITU-T Recommendation K.21

Like TIA/EIA-IS-968, K.21 requires an operation pass on a 37.5 A, 5/310 transverse current impulse, giving a minimum fuse I^2t of 0.45 A^2s . This value may be increased when the coordination test requirements are included. Depending on the conformance level, basic or enhanced, an a.c. power induction operational pass requires a minimum fuse I^2t of either a 1 A^2s or a 10 A^2s level.

APPLICATIONS INFORMATION

Fuses for UL 60950

Fuses for the UL 1950 power cross need to break the specified currents at 600 V a.c. - ordinary fuses will not do! Fuse specification terms like *short circuit capabilities to UL 1459 and UL 1950/60950, 40 A, 7 A and 2.2 A at 600 V a.c.* ensure that the 600 V breaking is met.

The requirement of Figure 3, box B, limits the fuse I^2t to less than 100 A²s.

Box C, with its 1.3 A limit gives a flow division. Modems passing the TIA/EIA-IS-968 Type A surge in a non-operational mode could use a fuse of 1 A rating or less and satisfy the 1.3 A limit and move to box D. Modems operationally passing the Type A surge will tend to use a 1.25 A fuse such as the Bel SMP 1.25, and move to box F. Fuses with ratings of 2 A and above may not operate before the wiring simulator fails (typically 3 A d.c.).


TISP4xxxL3BJ Overvoltage Protector Series

BOURNS®

MECHANICAL DATA

Recommended Printed Wiring Footprint

SMB Land Pattern

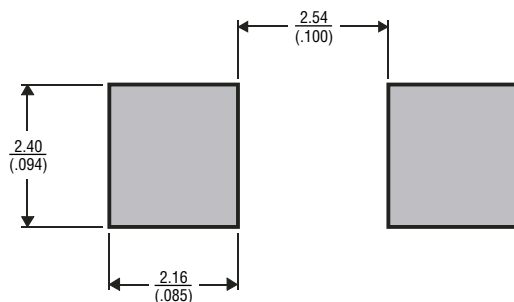

DIMENSIONS ARE: $\frac{\text{MM}}{(\text{INCHES})}$

MDXXBIB

Device Symbolization Code

Devices will be coded as below. As the device parameters are symmetrical, terminal 1 is not identified.

Device	Symbolization Code
TISP4070L3BJ	4070L3
TISP4350L3BJ	4350L3

Carrier Information

Devices are shipped in one of the carriers below. Unless a specific method of shipment is specified by the customer, devices will be shipped in the most practical carrier. For production quantities, the carrier will be embossed tape reel pack. Evaluation quantities may be shipped in bulk pack or embossed tape.

Carrier	Order As
Embossed Tape Reel Pack	TISP4xxxL3BJR-S
Bulk Pack	TISP4xxxL3BJ-S

"TISP" is a trademark of Bourns, Ltd., a Bourns Company, and is Registered in U.S. Patent and Trademark Office.
"Bourns" is a registered trademark of Bourns, Inc. in the U.S. and other countries.

AUGUST 1999 - REVISED JANUARY 2007
Specifications are subject to change without notice.
Customers should verify actual device performance in their specific applications.



Компания «ЭлектроПласт» предлагает заключение долгосрочных отношений при поставках импортных электронных компонентов на взаимовыгодных условиях!

Наши преимущества:

- Оперативные поставки широкого спектра электронных компонентов отечественного и импортного производства напрямую от производителей и с крупнейших мировых складов;
- Поставка более 17-ти миллионов наименований электронных компонентов;
- Поставка сложных, дефицитных, либо снятых с производства позиций;
- Оперативные сроки поставки под заказ (от 5 рабочих дней);
- Экспресс доставка в любую точку России;
- Техническая поддержка проекта, помощь в подборе аналогов, поставка прототипов;
- Система менеджмента качества сертифицирована по Международному стандарту ISO 9001;
- Лицензия ФСБ на осуществление работ с использованием сведений, составляющих государственную тайну;
- Поставка специализированных компонентов (Xilinx, Altera, Analog Devices, Intersil, Interpoint, Microsemi, Aeroflex, Peregrine, Syfer, Eurofarad, Texas Instrument, Miteq, Cobham, E2V, MA-COM, Hittite, Mini-Circuits, General Dynamics и др.);

Помимо этого, одним из направлений компании «ЭлектроПласт» является направление «Источники питания». Мы предлагаем Вам помощь Конструкторского отдела:

- Подбор оптимального решения, техническое обоснование при выборе компонента;
- Подбор аналогов;
- Консультации по применению компонента;
- Поставка образцов и прототипов;
- Техническая поддержка проекта;
- Защита от снятия компонента с производства.



Как с нами связаться

Телефон: 8 (812) 309 58 32 (многоканальный)

Факс: 8 (812) 320-02-42

Электронная почта: org@eplast1.ru

Адрес: 198099, г. Санкт-Петербург, ул. Калинина, дом 2, корпус 4, литера А.