


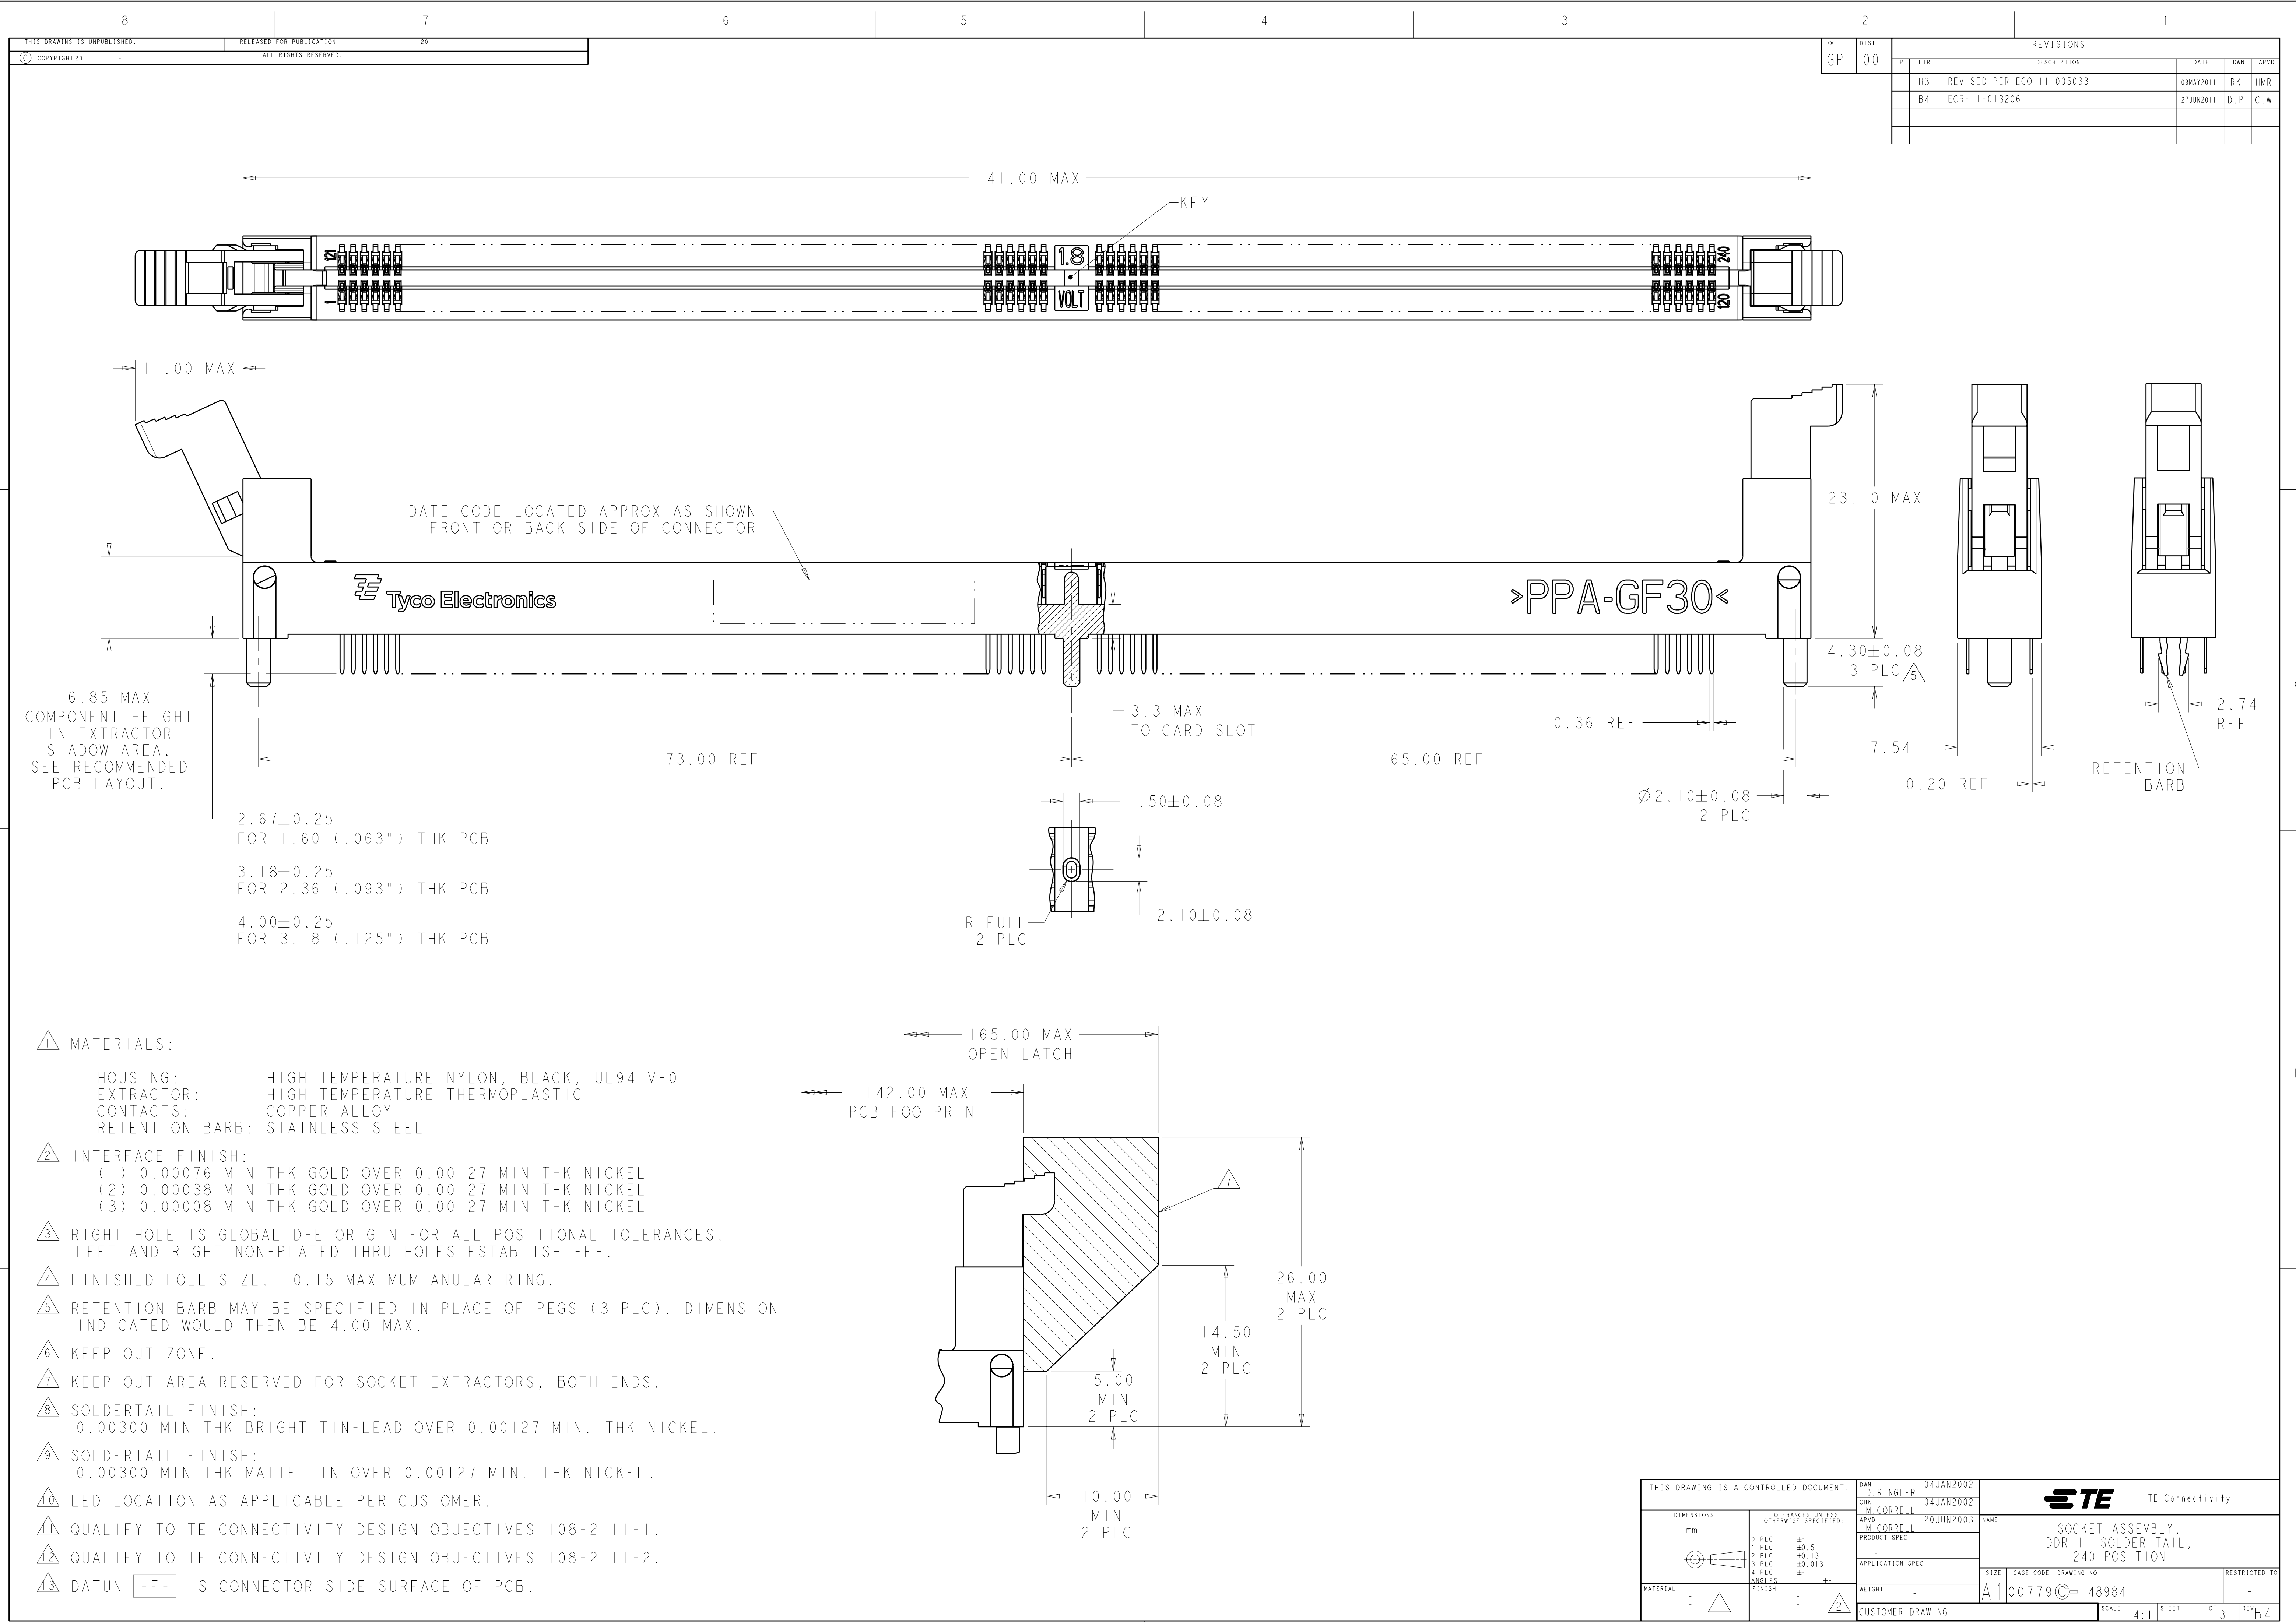

LOC		DIST		REVISIONS					
GP		00		REV	LYR	DESCRIPTION	DATE	DWN	APVD
				B3		REVISED PER ECO-11-005033	09MAY2011	RK	HMR
				B4		ECR-11-013206	27JUN2011	D, P	C, W

THIS DRAWING IS A CONTROLLED DOCUMENT.		DWN	D. RINGLER	04JAN2002	TE Connectivity			
DIMENSIONS:		CHK	M. CORRELL	04JAN2002				
mm		APVD	M. CORRELL	20JUN2003	NAME			
		TOLERANCES UNLESS OTHERWISE SPECIFIED:			PRODUCT SPEC			
		9 PLC ±.5			APPLICATION SPEC			
		3 PLC ±0.13			SIZE			
		5 PLC ±0.13			CAGE CODE			
		4 PLC ±.5			DRAWING NO			
		FINISH			A100779C=1489841			
MATERIAL		WEIGHT			RESTRICTED TO			
-		-			CUSTOMER DRAWING			
-		-			SCALE 4:1 SHEET 1 OF 3 REV B4			

THIS DRAWING IS UNPUBLISHED.

RELEASED FOR PUBLICATION

20

ALL RIGHTS RESERVED.

LOC

DIST

GP

00

REV

LYR

DESCRIPTION

DATE

DWN

APVD

SEE SHEET 1

LED TARGET ZONE REF

4.25 REF

LED PLACED IN "Y" DIRECTION

2.10

LED PLACED IN "X" DIRECTION

1.35

LED CENTER IN "X" OR "Y" DIRECTIONS

4.25

LED PLACED IN "X" DIRECTION

2.10

LED PLACED IN "Y" DIRECTION

1.35

LED HEIGHT OFF BOARD

1.23

LED PLACED IN "X" DIRECTION

2.10

LED PLACED IN "Y" DIRECTION

1.35

LED CENTER IN "X" OR "Y" DIRECTIONS

4.25

PARTIAL BOTTOM VIEW

SCALE 12:1

SECTION G-G

SCALE 12:1

	BLACK	$\triangle 9$	0.00038 MIN	3.18	RETENTION BARB	3-1489841-9	$\triangle 2$
	BLACK	$\triangle 9$	0.00038 MIN	2.67	RETENTION BARB	3-1489841-8	$\triangle 2$
	BLACK	$\triangle 8$	0.00038 MIN	2.67	RETENTION BARB	3-1489841-7	$\triangle 2$
SUPERCEDED BY 3-1489841-3	NATURAL	$\triangle 9$	0.00000 MIN	4.00	RETENTION BARB	3-1489841-6	$\triangle 2$
SUPERCEDED BY 3-1489841-2	NATURAL	$\triangle 9$	0.00000 MIN	3.18	RETENTION BARB	3-1489841-5	$\triangle 2$
SUPERCEDED BY 3-1489841-1	NATURAL	$\triangle 9$	0.00008 MIN	2.67	RETENTION BARB	3-1489841-4	$\triangle 2$
	NATURAL	$\triangle 9$	0.00038 MIN	4.00	RETENTION BARB	3-1489841-3	$\triangle 2$
	NATURAL	$\triangle 9$	0.00038 MIN	3.18	RETENTION BARB	3-1489841-2	$\triangle 2$
	NATURAL	$\triangle 9$	0.00038 MIN	2.67	RETENTION BARB	3-1489841-1	$\triangle 2$
	NATURAL	$\triangle 9$	0.00076 MIN	4.00	RETENTION BARB	3-1489841-0	$\triangle 1$
	NATURAL	$\triangle 9$	0.00076 MIN	3.18	RETENTION BARB	2-1489841-9	$\triangle 1$
	NATURAL	$\triangle 9$	0.00076 MIN	2.67	RETENTION BARB	2-1489841-8	$\triangle 1$
SUPERCEDED BY 2-1489841-4	NATURAL	$\triangle 9$	0.00000 MIN	4.00	PLASTIC POST	2-1489841-7	$\triangle 2$
SUPERCEDED BY 2-1489841-3	NATURAL	$\triangle 9$	0.00000 MIN	3.18	PLASTIC POST	2-1489841-6	$\triangle 2$
SUPERCEDED BY 2-1489841-2	NATURAL	$\triangle 9$	0.00000 MIN	2.67	PLASTIC POST	2-1489841-5	$\triangle 2$
	NATURAL	$\triangle 9$	0.00038 MIN	4.00	PLASTIC POST	2-1489841-4	$\triangle 2$
	NATURAL	$\triangle 9$	0.00038 MIN	3.18	PLASTIC POST	2-1489841-3	$\triangle 2$
	NATURAL	$\triangle 9$	0.00038 MIN	2.67	PLASTIC POST	2-1489841-2	$\triangle 2$
OBSOLETE	NATURAL	$\triangle 9$	0.00076 MIN	4.00	PLASTIC POST	2-1489841-1	$\triangle 1$
	NATURAL	$\triangle 9$	0.00076 MIN	3.18	PLASTIC POST	2-1489841-0	$\triangle 1$
	NATURAL	$\triangle 9$	0.00076 MIN	2.67	PLASTIC POST	1-1489841-9	$\triangle 1$
SUPERCEDED BY 3-1489841-3	NATURAL	$\triangle 8$	0.00000 MIN	4.00	RETENTION BARB	1-1489841-8	$\triangle 2$
SUPERCEDED BY 3-1489841-2	NATURAL	$\triangle 8$	0.00000 MIN	3.18	RETENTION BARB	1-1489841-7	$\triangle 2$
SUPERCEDED BY 3-1489841-1	NATURAL	$\triangle 8$	0.00000 MIN	2.67	RETENTION BARB	1-1489841-6	$\triangle 2$
SUPERCEDED BY 3-1489841-3	NATURAL	$\triangle 8$	0.00030 MIN	4.00	RETENTION BARB	1-1489841-5	$\triangle 2$
	NATURAL	$\triangle 8$	0.00038 MIN	3.18	RETENTION BARB	1-1489841-4	$\triangle 2$
	NATURAL	$\triangle 8$	0.00038 MIN	2.67	RETENTION BARB	1-1489841-3	$\triangle 2$
SUPERCEDED BY 3-1489841-0	NATURAL	$\triangle 8$	0.00076 MIN	4.00	RETENTION BARB	1-1489841-2	$\triangle 1$
	NATURAL	$\triangle 8$	0.00076 MIN	3.18	RETENTION BARB	1-1489841-1	$\triangle 1$
SUPERCEDED BY 2-1489841-8	NATURAL	$\triangle 8$	0.00076 MIN	2.67	RETENTION BARB	1-1489841-0	$\triangle 1$
SUPERCEDED BY 2-1489841-4	NATURAL	$\triangle 8$	0.00000 MIN	4.00	PLASTIC POST	1489841-9	$\triangle 2$
SUPERCEDED BY 2-1489841-3	NATURAL	$\triangle 8$	0.00000 MIN	3.18	PLASTIC POST	1489841-8	$\triangle 2$
SUPERCEDED BY 2-1489841-2	NATURAL	$\triangle 8$	0.00000 MIN	2.67	PLASTIC POST	1489841-7	$\triangle 2$
SUPERCEDED BY 2-1489841-4	NATURAL	$\triangle 8$	0.00030 MIN	4.00	PLASTIC POST	1489841-6	$\triangle 2$
SUPERCEDED BY 2-1489841-3	NATURAL	$\triangle 8$	0.00038 MIN	3.18	PLASTIC POST	1489841-5	$\triangle 2$
SUPERCEDED BY 2-1489841-2	NATURAL	$\triangle 8$	0.00030 MIN	2.67	PLASTIC POST	1489841-4	$\triangle 2$
SUPERCEDED BY 2-1489841-1	NATURAL	$\triangle 8$	0.00076 MIN	4.00	PLASTIC POST	1489841-3	$\triangle 1$
SUPERCEDED BY 2-1489841-0	NATURAL	$\triangle 8$	0.00076 MIN	3.18	PLASTIC POST	1489841-2	$\triangle 1$
SUPERCEDED BY 1-1489841-9	NATURAL	$\triangle 8$	0.00076 MIN	2.67	PLASTIC POST	1489841-1	$\triangle 1$
	EXTRACTOR COLOR	SOLDER TAIL	CONTACT GOLD INTERFACE	TAIL LENGTH	HOUSING STYLE	PART NUMBER	

THIS DRAWING IS A CONTROLLED DOCUMENT.

DIMENSIONS: mm

TOLERANCES UNLESS OTHERWISE SPECIFIED:

9 PLC ± 0.5

1 PLC ± 0.13

3 PLC ± 0.013

4 PLC $\pm$

ANGLES $\pm$

FINISH

MATERIAL

DWN

D. RINGLER

04JAN2002

CHK

M. CORRELL

04JAN2002

APVD

M. CORRELL

20JUN2003

NAME

PRODUCT SPEC

APPLICATION SPEC

WEIGHT

CUSTOMER DRAWING

TE Connectivity

SOCKET ASSEMBLY, DDR II SOLDER TAIL, 240 POSITION

SIZE

CAGE CODE

DRAWING NO

RESTRICTED TO

SCALE

4:1

SHEET

2


OF

3

REV

B4

4805 (3/11)

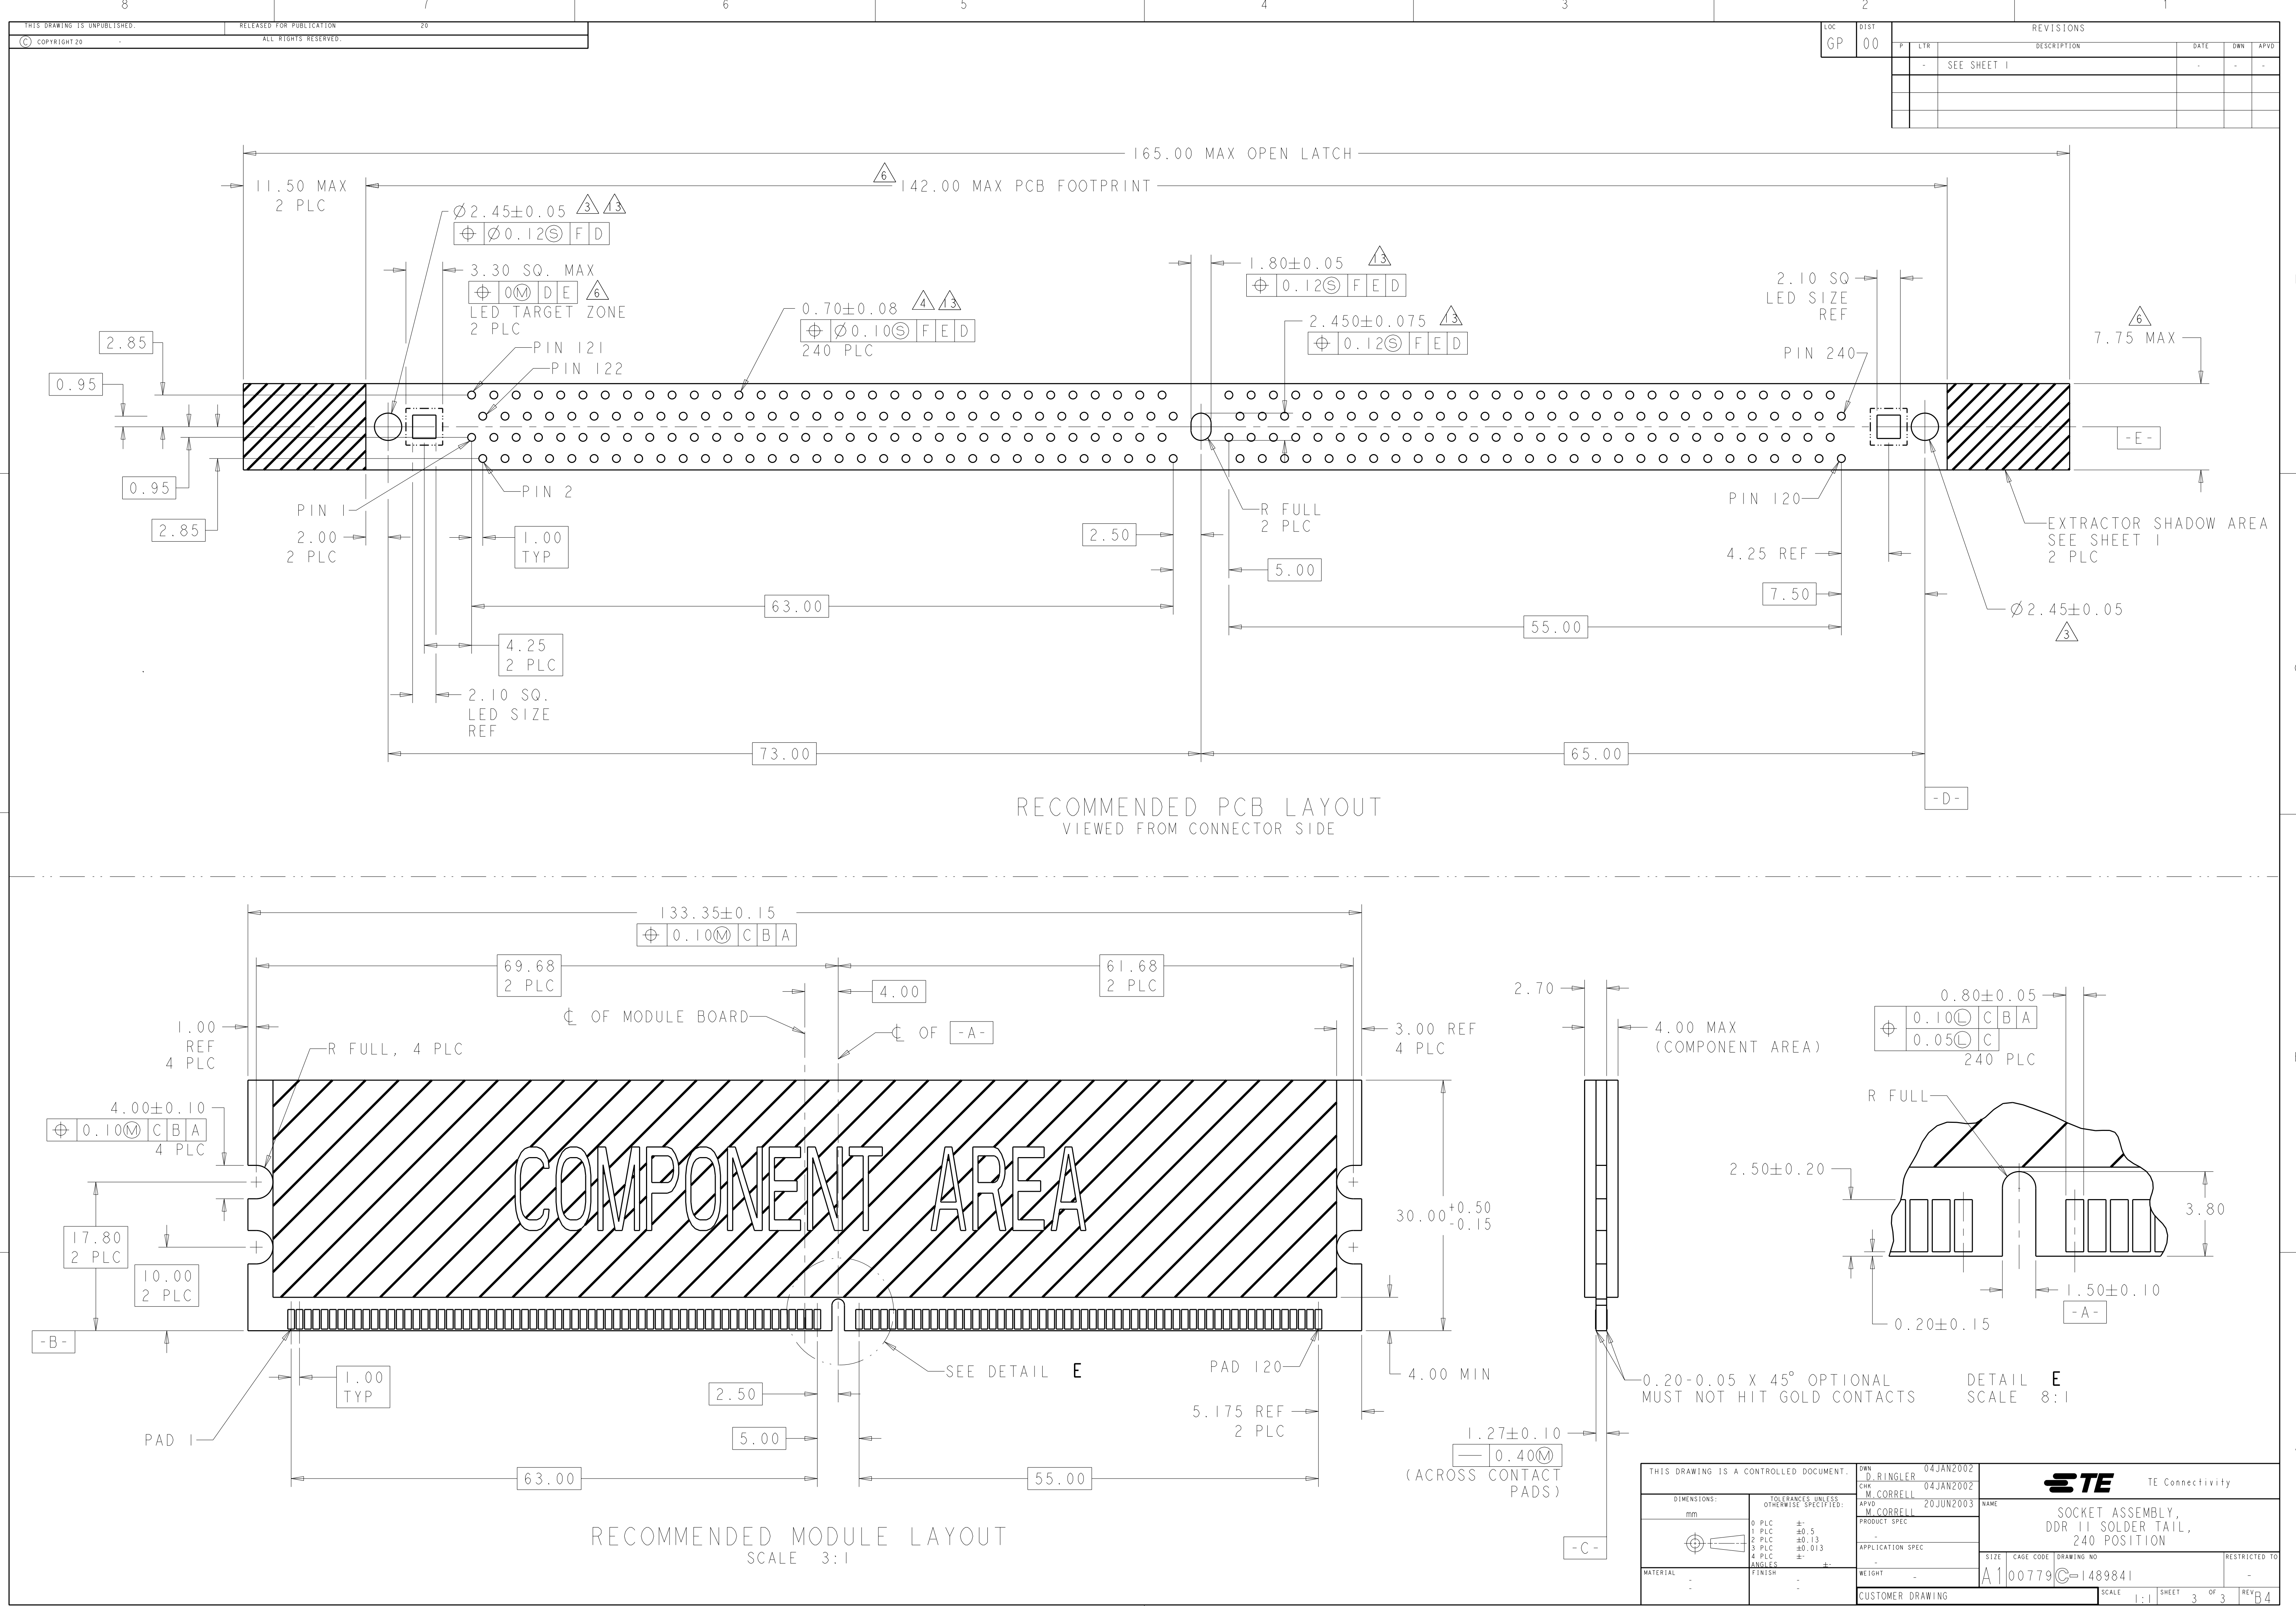



Компания «ЭлектроПласт» предлагает заключение долгосрочных отношений при поставках импортных электронных компонентов на взаимовыгодных условиях!

Наши преимущества:

- Оперативные поставки широкого спектра электронных компонентов отечественного и импортного производства напрямую от производителей и с крупнейших мировых складов;
- Поставка более 17-ти миллионов наименований электронных компонентов;
- Поставка сложных, дефицитных, либо снятых с производства позиций;
- Оперативные сроки поставки под заказ (от 5 рабочих дней);
- Экспресс доставка в любую точку России;
- Техническая поддержка проекта, помощь в подборе аналогов, поставка прототипов;
- Система менеджмента качества сертифицирована по Международному стандарту ISO 9001;
- Лицензия ФСБ на осуществление работ с использованием сведений, составляющих государственную тайну;
- Поставка специализированных компонентов (Xilinx, Altera, Analog Devices, Intersil, Interpoint, Microsemi, Aeroflex, Peregrine, Syfer, Eurofarad, Texas Instrument, Miteq, Cobham, E2V, MA-COM, Hittite, Mini-Circuits, General Dynamics и др.);

Помимо этого, одним из направлений компании «ЭлектроПласт» является направление «Источники питания». Мы предлагаем Вам помощь Конструкторского отдела:

- Подбор оптимального решения, техническое обоснование при выборе компонента;
- Подбор аналогов;
- Консультации по применению компонента;
- Поставка образцов и прототипов;
- Техническая поддержка проекта;
- Защита от снятия компонента с производства.



Как с нами связаться

Телефон: 8 (812) 309 58 32 (многоканальный)

Факс: 8 (812) 320-02-42

Электронная почта: org@eplast1.ru

Адрес: 198099, г. Санкт-Петербург, ул. Калинина, дом 2, корпус 4, литера А.