



Digital Supervisor

D44TL1A0



For use with VI Chip® BCM Bus Converter Module

Features

- PMBus™ compatible host interface for enhanced monitoring and control of ChiP BCM Bus Converter Modules
- Interfaces with up to four BCMs through dedicated UART interfaces via Vicor Digital Isolators I13TL1A0 enabling secondary referenced BCM control and telemetry
- OVP, OCP, OTP protection and monitoring
- 10 mm x 10 mm Land Grid Array (LGA) package

Typical Applications

- 380 VDC Power Distribution
- High End Computing Systems
- Automated Test Equipment
- Industrial Systems
- High Density Power Supplies
- Communications Systems
- Transportation


Product Description

The D44TL1A0 is a digital power system supervisor which provides a communication interface between a host processor and up to four ChiP BCM Bus Converter Modules. The Supervisor communicates with a system controller via a PMBus compatible interface. Acting as a communication bridge, the Supervisor communicates with up to four BCM Bus Converter Modules over isolated UART interfaces. Through the D44TL1A0, the host processor can configure, set protection limits, and monitor each BCM.


Standard Models

| Part Number | Package Type | Temperature |
|-------------|------------------|--------------------------|
| D44TL1A0 | LGA (10 x 10 mm) | T-Grade (-40°C to 125°C) |

Typical Application

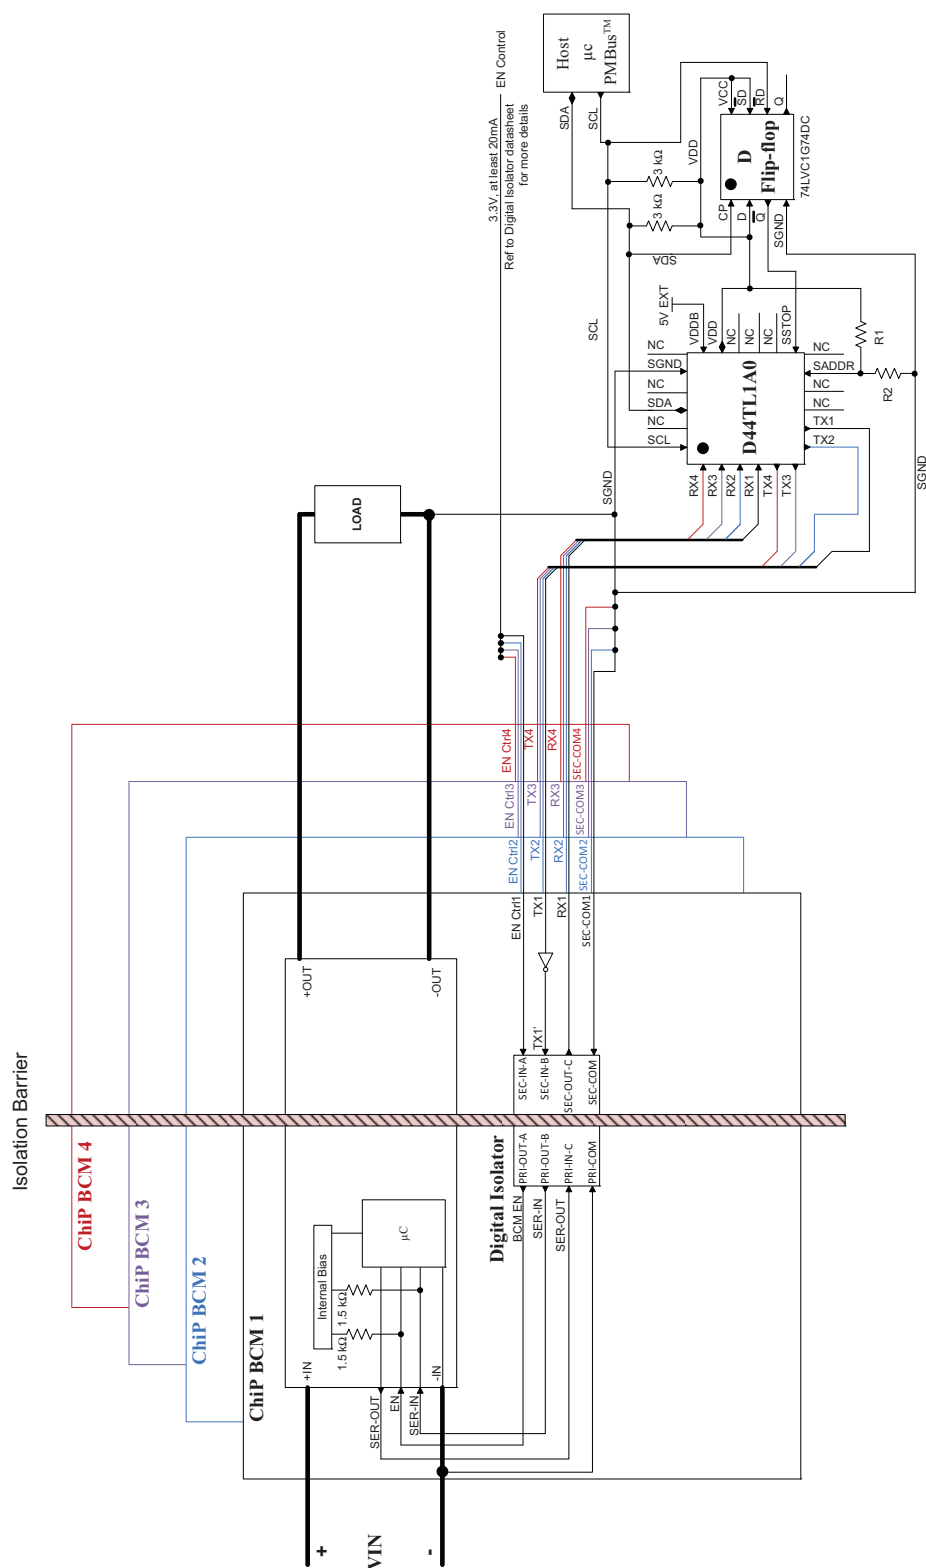

Pin Configuration

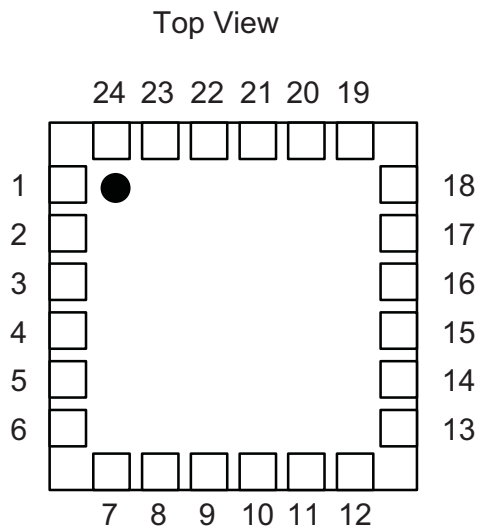

| Designator | Signal Name |
|------------|-------------|
| 1 | RX4 |
| 2 | RX3 |
| 3 | RX2 |
| 4 | RX1 |
| 5 | TX4 |
| 6 | TX3 |
| 7 | TX2 |
| 8 | TX1 |
| 9 | NC |
| 10 | NC |
| 11 | SADDR |
| 12 | NC |
| 13 | SSTOP |
| 14 | NC |
| 15 | NC |
| 16 | NC |
| 17 | VDD |
| 18 | VDDB |
| 19 | NC |
| 20 | SGND |
| 21 | NC |
| 22 | SDA |
| 23 | NC |
| 24 | SCL |

Pin Description

| PIN Number | Signal Name | PIN Type | Function |
|------------|-------------|----------------|---|
| 1 | RX4 | INPUT | UART Receiver. Receive data from BCM ₄ |
| 2 | RX3 | INPUT | UART Receiver. Receive data from BCM ₃ |
| 3 | RX2 | INPUT | UART Receiver. Receive data from BCM ₂ |
| 4 | RX1 | INPUT | UART Receiver. Receive data from BCM ₁ |
| 5 | TX4 | OUTPUT | UART Transmitter. Send data to BCM ₄ |
| 6 | TX3 | OUTPUT | UART Transmitter. Send data to BCM ₃ |
| 7 | TX2 | OUTPUT | UART Transmitter. Send data to BCM ₂ |
| 8 | TX1 | OUTPUT | UART Transmitter. Send data to BCM ₁ |
| 11 | SADDR | INPUT | I ² C address assignment |
| 13 | SSTOP | INPUT | I ² C REPEATED START decoded input Driven by Q-bar output of external D-Flip-flop |
| 17 | VDD | POWER | Regulated supply input + 3.3 V nominal, used to power internal sub-circuitry Regulated supply output, + 3.3 V nominal when Digital Supervisor is powered by VDDB |
| 18 | VDDB | POWER | Unregulated supply input |
| 20 | SGND | POWER | Signal ground |
| 22 | SDA | INPUT / OUTPUT | I ² C Data, PMBus™ Compatible |
| 24 | SCL | INPUT | I ² C Clock, PMBus Compatible |
| 9 | NO CONNECT | | |
| 10 | | | |
| 12 | | | |
| 14 | | | |
| 15 | | | |
| 16 | | | |
| 19 | | | |
| 21 | | | |
| 23 | | | |

Absolute Maximum Ratings

The absolute maximum ratings below are stress ratings only. Operation at or beyond these maximum ratings can cause permanent damage to the device.

| Parameter | Comments | Min | Max | Unit |
|--------------------|----------|------|---------------------------|------|
| VDD | | -0.3 | 4.6 | V |
| I _{VDD} | | | 0.15 | A |
| VDDB | | -0.3 | 17.6 | V |
| RX4, RX3, RX2, RX1 | | -0.3 | 4.6 | V |
| TX4, TX3, TX2, TX1 | | -0.3 | V _{VDD_IN} + 0.5 | V |
| SADDR, SSTOP | | -0.3 | 3.6 | V |
| SCL, SDA | | -0.3 | 5.5 | V |

Signal Characteristics

Specifications apply over the rated supply range (VDD or VDDB), unless otherwise noted; **Boldface** specifications apply over the temperature range of -40°C ≤ T_{INTERNAL} ≤ 125°C (T-Grade); All other specifications are at T_{INTERNAL} = 25°C unless otherwise noted.

| VDD Pin | | | | | | | | |
|---|-------------------|----------------------------|----------------------|---|-------------|------|-------------|------|
| <ul style="list-style-type: none"> Regulated supply power input to the module, required when VDDB is not used to supply power to the device. Regulated output 3.3 V nominal output when supervisor is powered by VDDB. Intended to be used as low current supply for ancillary circuits. | | | | | | | | |
| SIGNAL TYPE | STATE | ATTRIBUTE | SYMBOL | CONDITIONS / NOTES | MIN | TYP | MAX | UNIT |
| POWER INPUT | Regular Operation | VDD Voltage input | V _{VDD_IN} | | 3.0 | 3.3 | 3.6 | V |
| | | VDD Current consumption | I _{VDD_IN} | | | | 50 | mA |
| | Startup | Inrush Current Peak | I _{VDD_INR} | V _{VDD_IN} Slew Rate = 1 V/μs | | 2.5 | | A |
| | | Turn on time | t _{VDD_ON} | From V _{VDD_IN_MIN} to PMBus™ active | | 1.5 | | ms |
| POWER OUTPUT | Regular Operation | VDD Voltage output | V _{VDD_OUT} | | 3.23 | 3.30 | 3.37 | V |
| | | VDD source Current | I _{VDD_OUT} | | | | 50 | mA |
| | Transition | VDD Capacitance (External) | C _{VDD_EXT} | | | | 1 | μF |

| VDDB Pin | | | | | | | | |
|--|-------------------|--------------------------|-----------------------|--|------------|-----|-----------|------|
| <ul style="list-style-type: none"> Unregulated supply power input, required when VDD is not used as supply. This pin is a no connect pin if VDD pin is used to power the device. | | | | | | | | |
| SIGNAL TYPE | STATE | ATTRIBUTE | SYMBOL | CONDITIONS / NOTES | MIN | TYP | MAX | UNIT |
| POWER INPUT | Regular Operation | VDDB Voltage | V _{VDDB} | | 3.6 | | 16 | V |
| | | VDDB Current consumption | I _{VDDB} | | | | 50 | mA |
| | Startup | Inrush Current Peak | I _{VDDB_INR} | V _{VDDB} Slew Rate = 1 V/μs | | 3.5 | | A |
| | | Turn on time | t _{VDDB_ON} | From V _{VDDB_MIN} to PMBus active | | 1.5 | | ms |

| SGND Pin | | | | | | | | |
|--|--|--|--|--|--|--|--|--|
| <ul style="list-style-type: none"> Power supply return pin, and reference for all Digital Supervisor signal Input / Output. | | | | | | | | |


Signal Characteristics (Cont.)

Specifications apply over the rated supply range (VDD or VDD_B), unless otherwise noted; **Boldface** specifications apply over the temperature range of $-40^{\circ}\text{C} \leq T_{\text{INTERNAL}} \leq 125^{\circ}\text{C}$ (T-Grade); All other specifications are at $T_{\text{INTERNAL}} = 25^{\circ}\text{C}$ unless otherwise noted.

Serial Clock input (SCL) AND Serial Data (SDA) Pins

- High-power SMBus specification and SMBus physical layer compatible. Note that optional SMBALERT# is signal not supported.
- PMBus™ command compatible.
- The Digital Supervisor requires the use of a flip-flop to drive SSTOP. See system diagram section for more details.

| SIGNAL TYPE | STATE | ATTRIBUTE | SYMBOL | CONDITIONS / NOTES | MIN | TYP | MAX | UNIT |
|-------------------------|----------------------|---|-----------------|--|-----|-----|-----|---------------|
| DIGITAL INPUT/OUTPUT | Regular Operation | Electrical Parameters | | | | | | |
| | | Input Voltage Threshold | V_{IH} | $V_{VDD_IN} = 3.3\text{ V}$ | 2.3 | | | V |
| | | | V_{IL} | $V_{VDD_IN} = 3.3\text{ V}$ | | | 1 | V |
| | | Output Voltage Threshold | V_{OH} | $V_{VDD_IN} = 3.3\text{ V}$ | 2.8 | | | V |
| | | | V_{OL} | $V_{VDD_IN} = 3.3\text{ V}$ | | | 0.5 | V |
| | | Leakage current | I_{LEAK_PIN} | Unpowered device | -10 | | 10 | μA |
| | | Signal Sink Current | I_{LOAD} | $V_{OL} = 0.4\text{ V}$ | 4 | | | mA |
| | | Signal Capacitive Load | C_I | Total capacitive load of one device pin | | | 10 | pF |
| | | Signal Noise Immunity | V_{NOISE_PP} | 10 MHz to 100 MHz | 300 | | | mV |
| | | Timing Parameters | | | | | | |
| | | Operating Frequency | F_{SMB} | Idle state = 0 Hz | 10 | | 400 | KHz |
| | | Free time between Stop and Start Condition | t_{BUF} | | 1.3 | | | μs |
| | | Hold time after Start or Repeated Start condition | $t_{HD:STA}$ | First clock is generated after this hold time | 0.6 | | | μs |
| | | Repeat Start Condition Setup time | $t_{SU:STA}$ | | 0.6 | | | μs |
| | | Stop Condition setup time | $t_{SU:STO}$ | | 0.6 | | | μs |
| | | Data Hold time | $t_{HD:DAT}$ | | 300 | | | ns |
| | | Data Setup time | $t_{SU:DAT}$ | | 100 | | | ns |
| | | Clock low time out | $t_{TIMEOUT}$ | | 25 | | 35 | ms |
| | | Clock low period | t_{LOW} | | 1.3 | | | μs |
| | | Clock high period | t_{HIGH} | | 0.6 | | 50 | μs |
| | | Cumulative clock low extend time | $t_{LOW:SEXT}$ | | | | 25 | ms |
| | | Clock or Data Fall time | t_F | Measured from $(V_{IL_MAX} - 0.15)$ to $(V_{IH_MIN} + 0.15)$ | 20 | | 300 | ns |
| | | Clock or Data Rise time | t_R | $0.9 \cdot V_{VDD_IN_MAX}$ to $(V_{IL_MAX} - 0.15)$ | 20 | | 300 | ns |

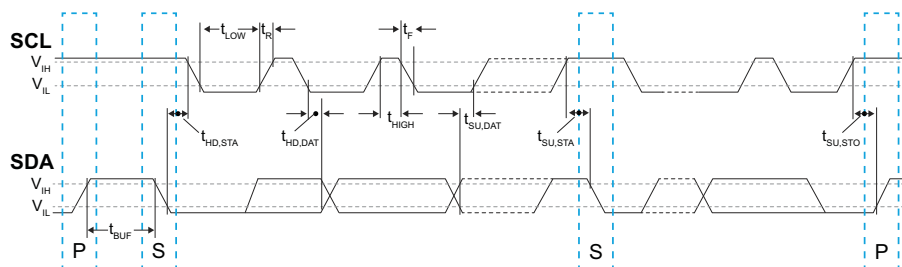

Signal Characteristics (Cont.)


Specifications apply over the rated supply range (VDD or VDD_B), unless otherwise noted; **Boldface** specifications apply over the temperature range of -40°C ≤ T_{INTERNAL} ≤ 125°C (T-Grade); All other specifications are at T_{INTERNAL} = 25°C unless otherwise noted.

| UART TX / RX Pins | | | | | | | | | |
|--|-------------------|---------------------------------|----------------------|--------------------------------|---------|------|-----|--------|---|
| <div><div></div><div><ul style="list-style-type: none">• Universal Asynchronous Receiver/Transmitter (UART) pins.• Provide intra-system communication to a ChiP Bus Converter Module (BCM).• The Digital Supervisor requires a Digital Isolator I13TL1A0 in order to communicate to a BCM using the UART pins.</div></div> | | | | | | | | | |
| SIGNAL TYPE | STATE | ATTRIBUTE | SYMBOL | CONDITIONS / NOTES | MIN | TYP | MAX | UNIT | |
| GENERAL I/O | Regular Operation | Baud Rate | BR _{UART} | | | 750 | | Kbit/s | |
| DIGITAL INPUT | | RX Receive Pin | | | | | | | |
| | | RX Input Voltage Threshold | V _{RX_IH} | | 2.0 | | | | V |
| | | | V _{RX_IL} | | | | 0.8 | | V |
| | | RX rise time | t _{RX_RISE} | 10% to 90% | | 150 | | ns | |
| | | RX fall time | t _{RX_FALL} | 10% to 90% | | 30 | | ns | |
| | | RX internal R _{PULLUP} | R _{RX_PLP} | Pull up to V _{VDD_IN} | | 1.5 | | kΩ | |
| | | RX external Capacitance | C _{RX_EXT} | | | | 120 | pF | |
| DIGITAL OUTPUT | | TX Transmit Pin | | | | | | | |
| | | TX Output Voltage Threshold | V _{TX_OH} | x = V _{VDD_IN} | x - 0.4 | | | | V |
| | | | V _{TX_OL} | | | | 0.4 | | V |
| | | TX rise time | t _{TX_RISE} | 10% to 90% | | 150 | | ns | |
| | | TX fall time | t _{TX_FALL} | 10% to 90% | | 30 | | ns | |
| | | TX source current | I _{TX} | | -24 | | 24 | mA | |
| | | TX output impedance | Z _{TX} | | | 12.5 | | Ω | |

| Serial Address (SADDR) Pin | | | | | | | | |
|--|-------------------|-------------------------|--------------------|--|-----|-----|-----|------|
| <ul style="list-style-type: none"> The Digital Supervisor supports only a fixed and persistent slave address. Using a voltage divider from VDD to signal ground. The address is sampled during startup and is used until power is reset. 16 Addresses are available. Relative to V_{VDD_NOM}, a 206.25 mV range per address. | | | | | | | | |
| SIGNAL TYPE | STATE | ATTRIBUTE | SYMBOL | CONDITIONS / NOTES | MIN | TYP | MAX | UNIT |
| MULTI-LEVEL INPUT | Regular Operation | SADDR Input Voltage | V _{SADDR} | See address section; x = V _{VDD_IN} | 0 | | x | V |
| | | SADDR leakage current | I _{SADDR} | Leakage current | | | 1 | μA |
| | Startup | SADDR registration time | t _{SADDR} | From V _{VDD_IN_MIN} | | 1 | | ms |

| Serial STOP (SSTOP) Pins | | | | | | | | |
|--|-------------------|-------------------------|-----------------------|-------------------------|---------|-----|---------|------|
| <ul style="list-style-type: none"> Input from a Flip-flop to drive SSTOP used to decode a REPEATED START signal. See system diagram section for more details. | | | | | | | | |
| SIGNAL TYPE | STATE | ATTRIBUTE | SYMBOL | CONDITIONS / NOTES | MIN | TYP | MAX | UNIT |
| DIGITAL INPUT | Regular Operation | SSTOP Voltage Threshold | V _{SSTOP_IH} | x = V _{VDD_IN} | 0.7 • x | | | V |
| | | | V _{SSTOP_IL} | x = V _{VDD_IN} | | | 0.3 • x | V |

Block Diagram

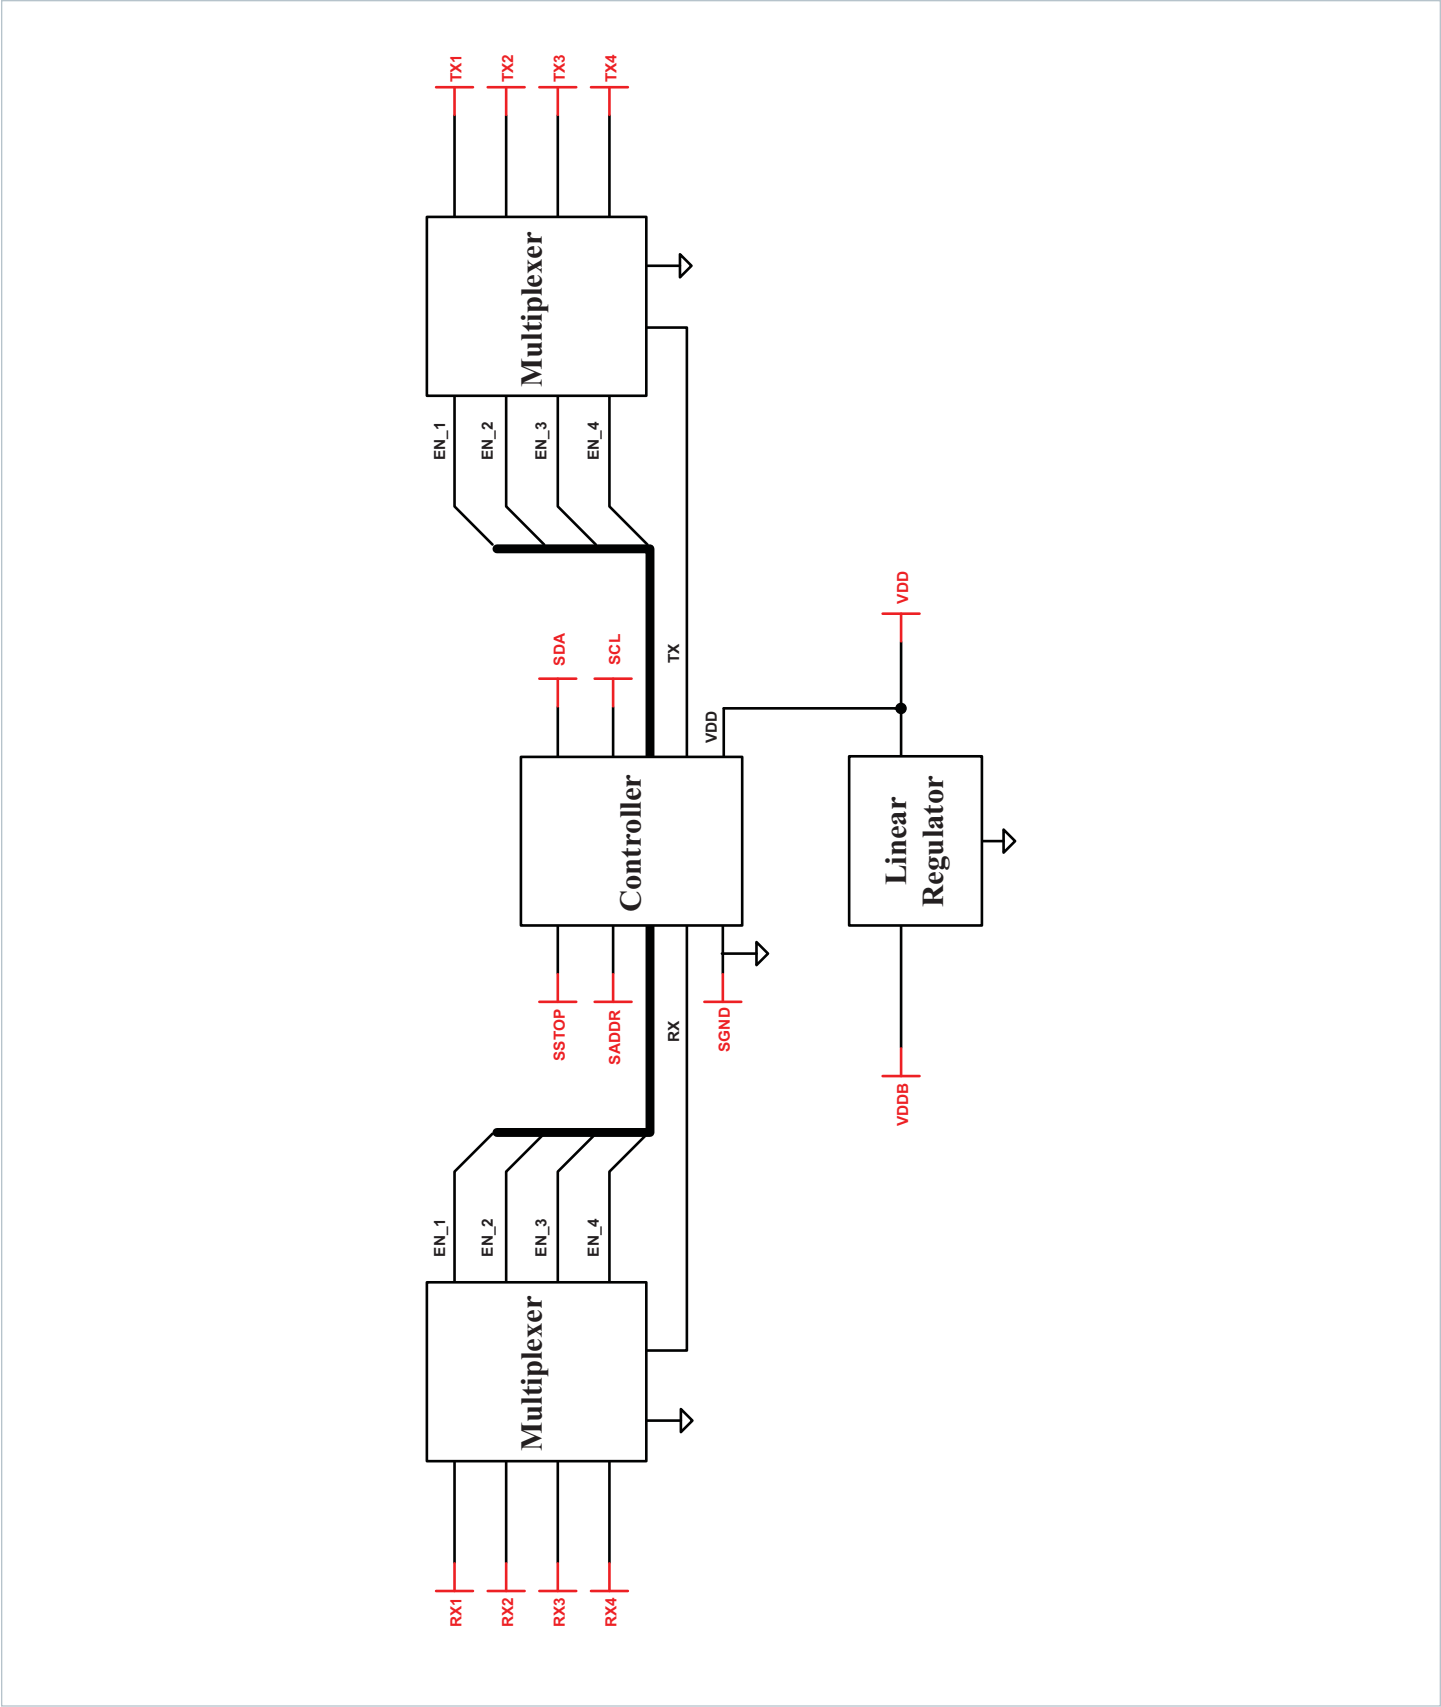


General Characteristics

Specifications apply over the rated supply range (VDD or VDDb), unless otherwise noted; **Boldface** specifications apply over the temperature range of $-40^{\circ}\text{C} \leq T_{\text{INTERNAL}} \leq 125^{\circ}\text{C}$ (T-Grade); All other specifications are at $T_{\text{INTERNAL}} = 25^{\circ}\text{C}$ unless otherwise noted.

| Attribute | Symbol | Conditions / Notes | Min | Typ | Max | Unit |
|---------------------------------|-----------------------|---|--------------|---------------|---------------|---------|
| | | | | | | |
| Mechanical | | | | | | |
| Length | L | | 9.90 / 0.390 | 10.00 / 0.394 | 10.10 / 0.398 | mm/[in] |
| Width | W | | 9.90 / 0.390 | 10.00 / 0.394 | 10.10 / 0.398 | mm/[in] |
| Height | H | | 1.89 / .075 | 1.97 / .078 | 2.05 / .081 | mm/[in] |
| Weight | W | | | 0.5 / 0.017 | | g/[oz] |
| Thermal | | | | | | |
| Operating temperature | T _{INTERNAL} | D44TL1A0 (T-Grade) | -40 | | 125 | °C |
| Assembly | | | | | | |
| Storage temperature | T _{ST} | D44TL1A0 (T-Grade) | -40 | | 125 | °C |
| Moisture Sensitivity Level | MSL | MSL4, 72 hrs out of bag | | | | |
| ESD Withstand | ESD _{HBM} | Human Body Model, "AEC Q100-002 > 2000 V" | | | | |
| | ESD _{CDM} | Charge Device Model, "AEC Q100-011 > 750 V" | | | | |
| | ESD _{MM} | Machine Model, "AEC Q100-003" > 200 V" | | | | |
| Soldering | | | | | | |
| Peak Temperature During Reflow | | Under MSL 4 conditions above | 235 | 245 | 260 | °C |
| Peak Time Above 217 °C | | | 30 | 60 | 90 | s |
| Peak Heating Rate During Reflow | | | 0.5 | 1.5 | 3.0 | °C/s |
| Peak Cooling Rate Post Reflow | | | 0.5 | 2.0 | 6.0 | °C/s |
| Quality / Reliability | | | | | | |
| MTBF | | MIL-HDBK-217Plus Parts Count – 25°C Ground Benign, Stationary, Indoors / Computer | | 21.6 | | MHrs |
| | | Telcordia Issue 2 – Method I Case III; 25°C Ground Benign, Controlled | | 24.4 | | |

System Functional Description

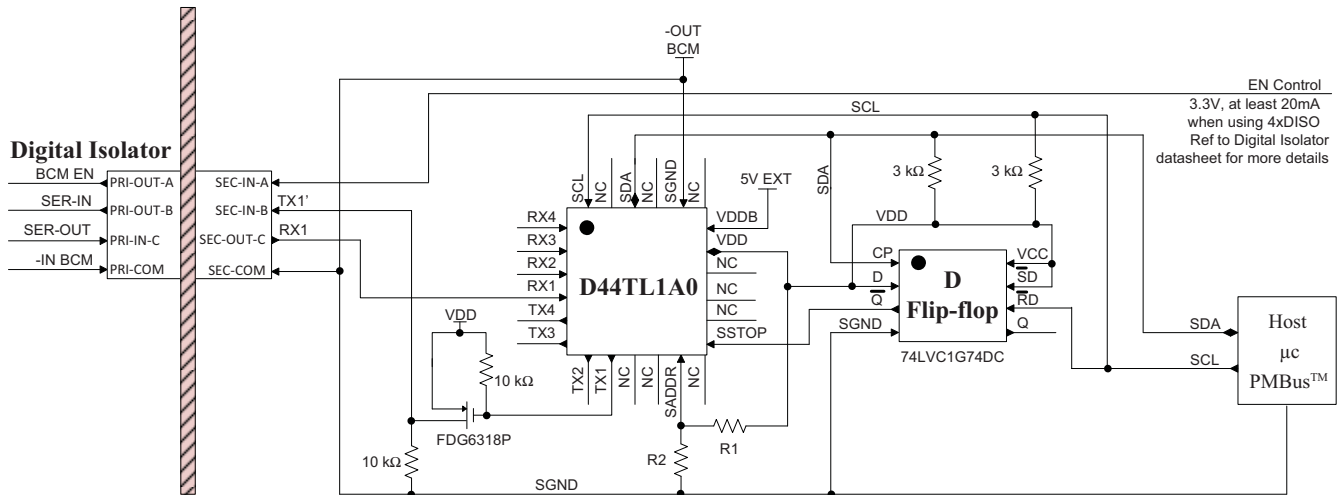

The Digital Supervisor provides the host system telemetry access to an array of up to four Bus Converter Modules (BCMs). The D44TL1A0 Digital Supervisor is a PMBus™ slave and will respond only to host commands listed in subsequent sections.

A Single D-type flip-flop is required to signal a STOP condition to a PMBus message.

The Digital Supervisor is a self-powered device as defined by the SMBus specification. The Digital Supervisor has two power input pins. VDDB is a wide range input that powers an internal regulator. When power is applied to VDDB, the VDD pin acts as a 3.3 V auxiliary power source. VDD can also be used as a 3.3 V nominal power input. In this case, VDDB must be left unconnected.

The TX1, TX2, TX3, TX4 pins of the Digital Supervisor require external buffering in order to fully bias the Digital Isolator channel. All signals are inverted by the Digital Isolator. Please refer to the Digital Isolator datasheet for additional details.

The Digital Isolator allows UART communication interface between the Digital Supervisor and the associated primary referenced BCM UART pins. Each Digital Isolator provides enough signal channels for one BCM. Each transmission channel is able to draw its bias power directly from the input signal being transmitted to the output.

The Digital Supervisor regularly polls the UART interface and stores the BCMs telemetry, faults and warnings. This updated data is then available for access by the host processor via the PMBus interface. BCM reported parameters calibration coefficient and calibration gain are factory set and are stored in individual BCMs ensuring specified telemetry accuracy is met. Refer to the respective BCM datasheet for more details.

A startup order of the Digital Supervisor or the BCM array is not required. The Digital Supervisor is constantly probing all UART pins to discover connected BCMs. Stored telemetry update rate is constant for a given number of BCMs. Worst case telemetry update is 12 ms and worst case update of non-volatile parameter after a write command is 200 ms.

The PMBus output voltage level setting commands and faults do not apply to the BCM. The BCM during normal operation will provide an output voltage proportional to its transfer ratio referred to as BCM K Factor.

Any available communication enabled BCM may be used with a Digital Supervisor. It is not required for the complete array of four BCMs to be of equivalent K factor in order to report to a single Digital Supervisor.

PMBus™ Interface

Refer to “PMBus Power System Management Protocol Specification Revision 1.2, Part I and II” for complete PMBus specifications details visit <http://pmbus.org>.

Device Address

The PMBus address (SADDR Pin) should be set to one of a predetermined 16 possible addresses shown in the table below using a voltage divider from VDD to SGND.

The Digital Supervisor accepts only a fixed and persistent address and does not support SMBus address resolution protocol. At initial power-up, the Digital Supervisor will sample the address pin voltage, and will hold this address until device power is removed.

| ID | Slave Address | HEX | Recommended Resistor Divider (Ω) | |
|----|---------------|-----|----------------------------------|-------|
| | | | R1 | R2 |
| 1 | 1010 000b | 50h | 13700 | 442 |
| 2 | 1010 001b | 51h | 13300 | 1370 |
| 3 | 1010 010b | 52h | 5760 | 1070 |
| 4 | 1010 011b | 53h | 7320 | 2050 |
| 5 | 1010 100b | 54h | 7150 | 2800 |
| 6 | 1010 101b | 55h | 5230 | 2740 |
| 7 | 1010 110b | 56h | 10700 | 7320 |
| 8 | 1010 111b | 57h | 16200 | 14300 |
| 9 | 1011 000b | 58h | 14300 | 16200 |
| 10 | 1011 001b | 59h | 7320 | 10700 |
| 11 | 1011 010b | 5Ah | 2740 | 5230 |
| 12 | 1011 011b | 5Bh | 5360 | 13700 |
| 13 | 1011 100b | 5Ch | 1690 | 6040 |
| 14 | 1011 101b | 5Dh | 1070 | 5760 |
| 15 | 1011 110b | 5Eh | 1370 | 13300 |
| 16 | 1011 111b | 5Fh | 442 | 13700 |

BCM Enable Control Pin

The BCM EN Control pin input from host processor can be used to turn the BCM powertrain on and off. The host will need to energize the Digital Isolator channels of all used BCMs.

For a synchronous BCM startup, it is possible to connect all four Digital Isolator pins (SER-IN-A) together. The input pin (SER-IN-A) to the Digital Isolator requires at a minimum 2.5 V and N times 5 mA per N number of channels driven for proper biasing. The output of each Digital Isolator pin (SER-OUT-A) can then drive the respective BCM EN pin. Refer to the Digital Isolator datasheet for more details.

The BCM EN pin has a higher priority level than the OPERATION COMMAND (01h). The BCM powertrain will remain off if the BCM EN pin is disabled.

Reported DATA Formats

The Digital Supervisor employs a direct data format where all reported Digital Supervisor measurements are in Volts, Amperes, Degrees Celsius, or Seconds. The host uses the following PMBus specification to interpret received values metric prefixes. Note that the Coefficients command is not supported:

$$X = \left(\frac{1}{m} \right) \cdot (Y \cdot 10^R - b)$$

Where:

X, is a “real world” value in units (A, V, °C, s)

Y, is a two's complement integer received from the Digital Supervisor
m, b and R are two's complement integers defined as follows:

| Command | Code | m | R | b |
|--------------------|------|-------|---|---|
| TON_DELAY | 60h | 1 | 3 | 0 |
| READ_VIN | 88h | 1 | 1 | 0 |
| READ_IIN | 89h | 1 | 3 | 0 |
| READ_VOUT | 8Bh | 1 | 1 | 0 |
| READ_IOUT | 8Ch | 1 | 2 | 0 |
| READ_TEMPERATURE_1 | 8Dh | 1 | 0 | 0 |
| READ_POUT | 96h | 1 | 0 | 0 |
| MFR_VIN_MIN | A0h | 1 | 0 | 0 |
| MFR_VIN_MAX | A1h | 1 | 0 | 0 |
| MFR_VOUT_MIN | A4h | 1 | 0 | 0 |
| MFR_VOUT_MAX | A5h | 1 | 0 | 0 |
| MFR_IOUT_MAX | A6h | 1 | 0 | 0 |
| MFR_POUT_MAX | A7h | 1 | 0 | 0 |
| READ_K_FACTOR | D1h | 65536 | 0 | 0 |
| READ_BCM_ROUT | D4h | 1 | 2 | 0 |

^[1] Default READ Output Voltage returned when BCM unit is disabled = -300 V.

^[2] Default READ Temperature returned when BCM unit is disabled = -273°C.

No special formatting is required when lowering the supervisory limits and warnings.

Supported Command List


| Command | Code | Function | Default Data Content | Data Bytes |
|---------------------|--------------------|---|----------------------|------------|
| PAGE | 00h | Access Digital Supervisor stored information for all connected devices | 00h | 1 |
| OPERATION | 01h | Turn BCMs on or off | 80h | 1 |
| ON_OFF_CONFIG | 02h | Defines startup when power is applied as well as immediate on/off control over the BCMs | 1Dh | 1 |
| CLEAR_FAULTS | 03h | Clear all BCM and all Digital Supervisor faults | N/A | None |
| CAPABILITY | 19h | Digital Supervisor PMBus™ key capabilities set by factory | 20h | 1 |
| OT_FAULT_LIMIT | 4Fh ^[1] | BCM over temperature protection | 64h | 2 |
| OT_WARN_LIMIT | 51h ^[1] | BCM over temperature warning | 64h | 2 |
| VIN_OV_FAULT_LIMIT | 55h ^[1] | BCM VIN overvoltage warning | 64h | 2 |
| VIN_OV_WARN_LIMIT | 57h ^[1] | BCM VIN overvoltage protection | 64h | 2 |
| IIN_OC_FAULT_LIMIT | 5Bh ^[1] | BCM IOUT overcurrent protection | 64h | 2 |
| IIN_OC_WARN_LIMIT | 5Dh ^[1] | BCM IOUT overcurrent warning | 64h | 2 |
| TON_DELAY | 60h ^[1] | Startup delay additional to any BCM fixed delays | 00h | 2 |
| STATUS_BYTE | 78h | Summary of BCM faults | 00h | 1 |
| STATUS_WORD | 79h | Summary of BCM fault conditions | 00h | 2 |
| STATUS_IOUT | 7Bh | BCM overcurrent fault status | 00h | 1 |
| STATUS_INPUT | 7Ch | BCM overvoltage and under voltage fault status | 00h | 1 |
| STATUS_TEMPERATURE | 7Dh | BCM over temperature and under temperature fault status | 00h | 1 |
| STATUS_CML | 7Eh | Digital Supervisor PMBus Communication fault | 00h | 1 |
| STATUS_MFR_SPECIFIC | 80h | Other BCM status indicator | 00h | 1 |
| READ_VIN | 88h | BCM input voltage | FFFFh | 2 |
| READ_IIN | 89h | BCM input current | FFFFh | 2 |
| READ_VOUT | 8Bh | BCM output voltage | FFFFh | 2 |
| READ_IOUT | 8Ch | BCM output current | FFFFh | 2 |
| READ_TEMPERATURE_1 | 8Dh | BCM temperature | FFFFh | 2 |
| READ_POUT | 96h | BCM output power | FFFFh | 2 |
| PMBUS_REVISION | 98h | Digital Supervisor PMBus compatible revision | 22h | 1 |
| MFR_ID | 99h | Digital Supervisor ID | "VI" | 2 |
| MFR_MODEL | 9Ah | Digital Supervisor or BCM model | Part Number | 18 |
| MFR_REVISION | 9Bh | Digital Supervisor or BCM revision | FW and HW revision | 18 |
| MFR_LOCATION | 9Ch | Digital Supervisor or BCM factory location | "AP" | 2 |
| MFR_DATE | 9Dh | Digital Supervisor or BCM manufacturing date | "YYWW" | 4 |
| MFR_SERIAL | 9Eh | Digital Supervisor or BCM serial number | Serial Number | 16 |
| MFR_VIN_MIN | A0h | BCM Minimum rated VIN | Varies per BCM | 2 |
| MFR_VIN_MAX | A1h | BCM Maximum rated VIN | Varies per BCM | 2 |
| MFR_VOUT_MIN | A4h | BCM Minimum rated VOUT | Varies per BCM | 2 |
| MFR_VOUT_MAX | A5h | BCM Maximum rated VOUT | Varies per BCM | 2 |
| MFR_IOUT_MAX | A6h | BCM Maximum rated IOUT | Varies per BCM | 2 |
| MFR_POUT_MAX | A7h | BCM Maximum rated POUT | Varies per BCM | 2 |
| BCM_EN_POLARITY | D0h ^[1] | Set BCM EN pin polarity | 02h | 1 |
| READ_K_FACTOR | D1h | BCM K factor | Varies per BCM | 2 |
| READ_BCM_ROUT | D4h | BCM Rout | Varies per BCM | 2 |
| SET_ALL_THRESHOLDS | D5h ^[1] | Set BCM supervisory warning and protection thresholds | 646464646464h | 6 |
| DISABLE_FAULT | D7h ^[1] | Disable BCM overvoltage, overcurrent or under voltage supervisory faults | 00h | 2 |

^[1] The BCM must be in a disabled state during a write message.

Command Structure Overview

Write Byte protocol:

The Host always initiates PMBus™ communication with a START bit. All messages are terminated by the Host with a STOP bit. In a write message, the master sends the slave device address followed by a write bit. Once the slave acknowledges, the master proceeds with the command code and then similarly the data byte.



S Start Condition

Sr Repeated start Condition

Rd Read

Wr Write

X Indicated that field is required to have the value of x

A Acknowledge (bit may be 0 for an ACK or 1 for a NACK)

P Stop Condition

From Master to Slave

From Slave to Master

... Continued next line

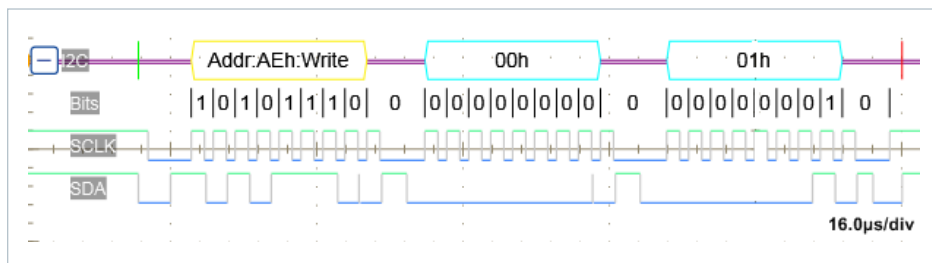


Figure 1 — PAGE COMMAND (00h), WRITE BYTE PROTOCOL

Read Byte protocol:

A Read message begins by first sending a Write Command, followed by a REPEATED START Bit and a slave Address. After receiving the READ bit, the Digital Supervisor begins transmission of the Data responding to the Command. Once the Host receives the requested Data, it terminates the message with a NACK preceding a stop condition signifying the end of a read transfer.

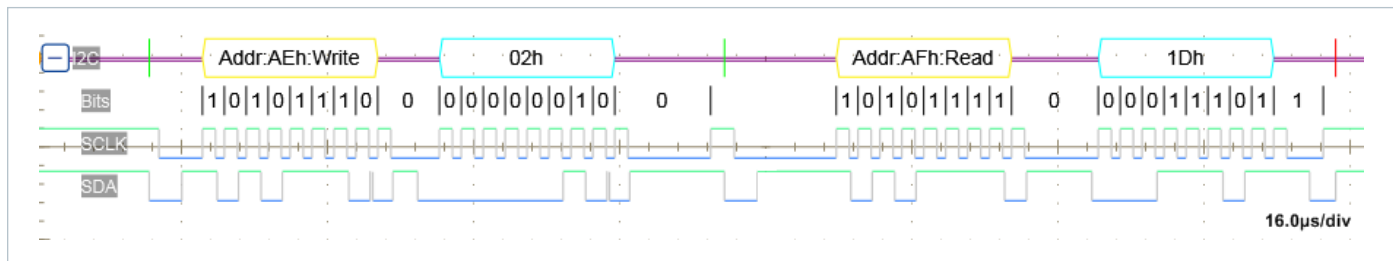



Figure 2 — ON_OFF_CONFIG COMMAND (02h), READ BYTE PROTOCOL

Write Word protocol:

When transmitting a word, the lowest order byte leads the highest order byte. Furthermore, when transmitting a Byte, the least significant bit (LSB) is sent last. Refer to System Management Bus (SMBus) specification version 2.0 for more details.

Note: Extended command and Packet Error Checking Protocols are not supported.

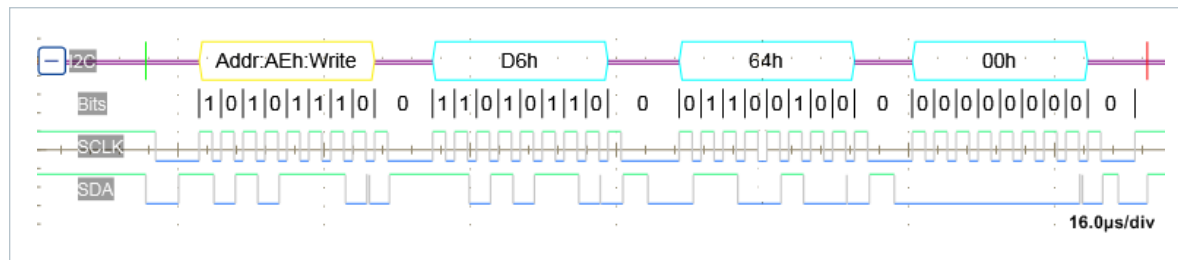



Figure 3 — TON_DELAY COMMAND (60h)_WRITE WORD PROTOCOL

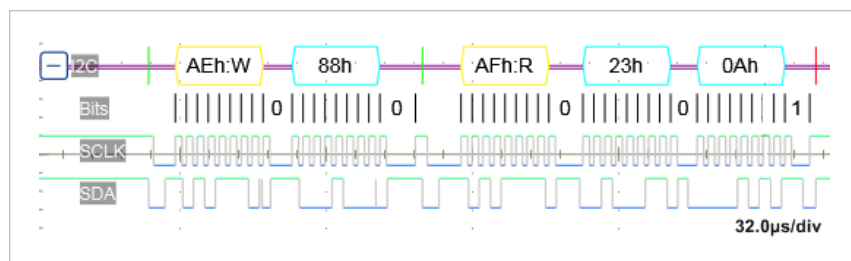

Read Word protocol:

Figure 4 — MFR_VIN_MIN COMMAND (A0h)_READ WORD PROTOCOL

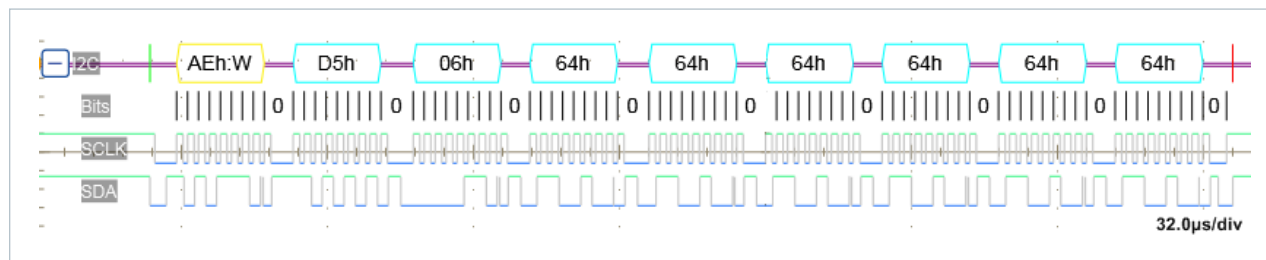
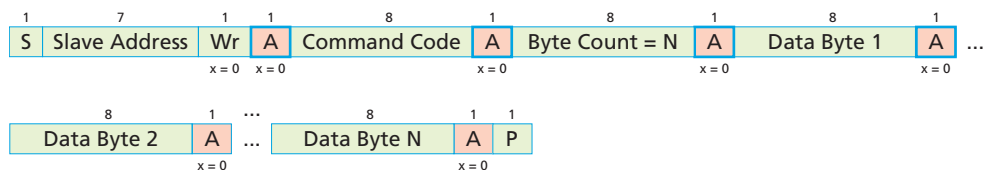
Write Block protocol:

Figure 5 — SET_ALL_THRESHOLDS COMMAND (D5h)_WRITE BLOCK PROTOCOL

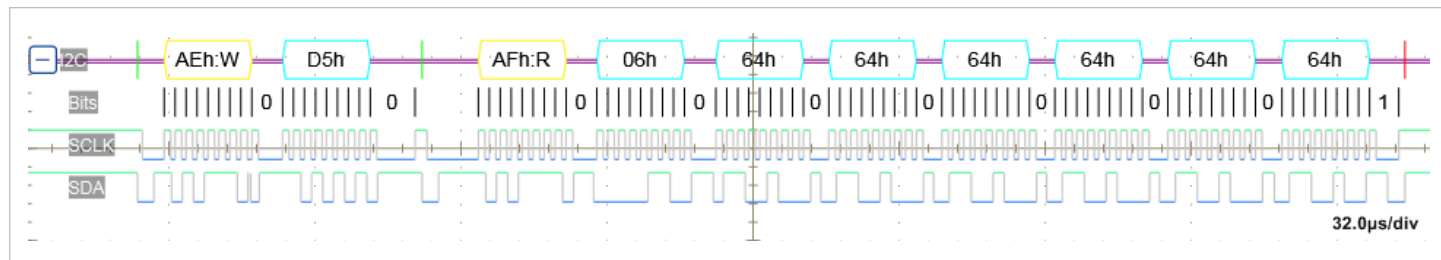
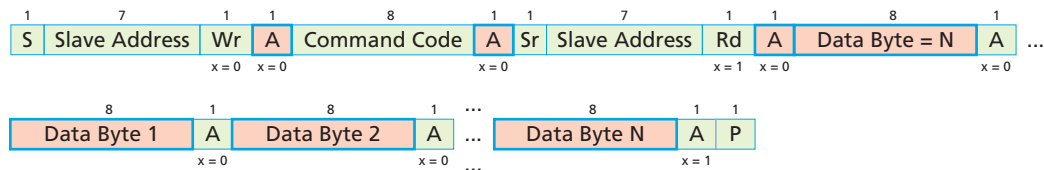
Read Block protocol:

Figure 6 — SET_ALL_THRESHOLDS COMMAND (D5h)_READ BLOCK PROTOCOL

Write Group Command protocol:

Note that only one command per device is allowed in a group command.

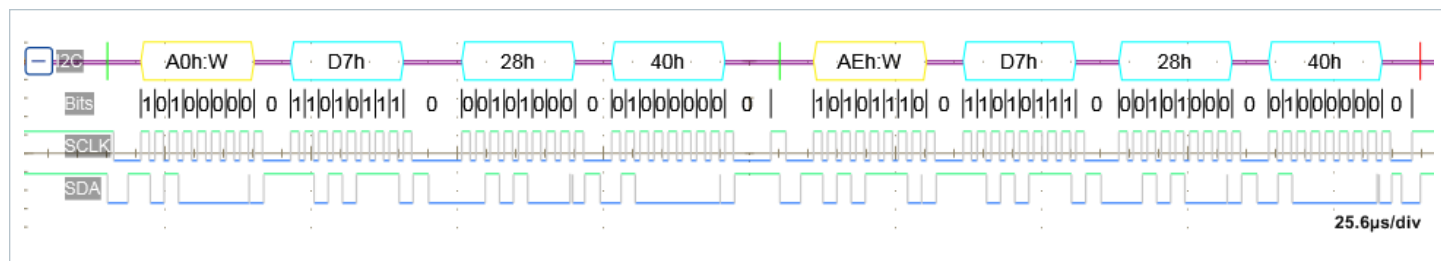
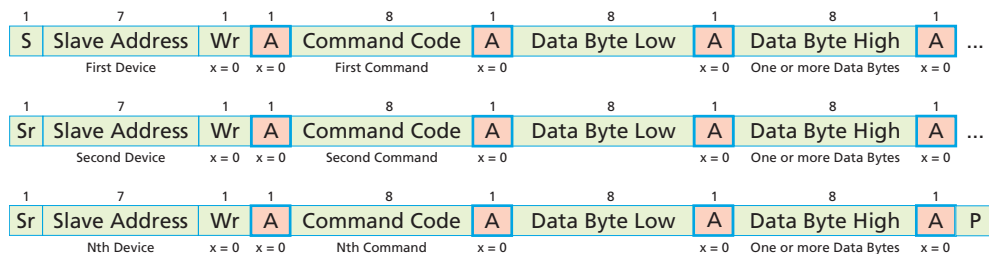


Figure 7 — DISABLE_FAULT COMMAND (D7h)_WRITE

Supported Commands Transaction type

A direct communication to the Digital Supervisor and a simulated communication to non-PMBus™ devices is enabled by a page command. Supported command access privileges with a pre-selected PAGE are defined in the following table. Deviation from this table generates a communication error in STATUS_CML register.

| Command | Code | PAGE Data Byte Access Type | | |
|---------------------|------|----------------------------|-----------|-----|
| | | 00h | 01h – 04h | FFh |
| PAGE | 00h | R/W | R/W | R/W |
| OPERATION | 01h | R ^[1] | R/W | W |
| ON_OFF_CONFIG | 02h | | R | |
| CLEAR_FAULTS | 03h | W | W | W |
| CAPABILITY | 19h | R | | |
| OT_FAULT_LIMIT | 4Fh | | R/W | W |
| OT_WARN_LIMIT | 51h | | R/W | W |
| VIN_OV_FAULT_LIMIT | 55h | | R/W | W |
| VIN_OV_WARN_LIMIT | 57h | | R/W | W |
| IIN_OC_FAULT_LIMIT | 5Bh | | R/W | W |
| IIN_OC_WARN_LIMIT | 5Dh | | R/W | W |
| TON_DELAY | 60h | | R/W | W |
| STATUS_BYTE | 78h | R/W ^[1] | R | |
| STATUS_WORD | 79h | R ^[1] | R | |
| STATUS_IOUT | 7Bh | R ^[1] | R/W | W |
| STATUS_INPUT | 7Ch | R ^[1] | R/W | W |
| STATUS_TEMPERATURE | 7Dh | R ^[1] | R/W | W |
| STATUS_CML | 7Eh | R/W | | |
| STATUS_MFR_SPECIFIC | 80h | R ^[1] | R/W | W |
| READ_VIN | 88h | | R | |
| READ_IIN | 89h | R ^[2] | R | |
| READ_VOUT | 8Bh | | R | |
| READ_IOUT | 8Ch | R ^[2] | R | |
| READ_TEMPERATURE_1 | 8Dh | R ^[3] | R | |
| READ_POUT | 96h | R ^[2] | R | |
| PMBUS_REVISION | 98h | R | | |
| MFR_ID | 99h | R | | |
| MFR_MODEL | 9Ah | R | R | |
| MFR_REVISION | 9Bh | R | R | |
| MFR_LOCATION | 9Ch | R | R | |
| MFR_DATE | 9Dh | R | R | |
| MFR_SERIAL | 9Eh | R | R | |
| MFR_VIN_MIN | A0h | R ^[4] | R | |
| MFR_VIN_MAX | A1h | R ^[5] | R | |
| MFR_VOUT_MIN | A4h | R ^[4] | R | |
| MFR_VOUT_MAX | A5h | R ^[5] | R | |
| MFR_IOUT_MAX | A6h | R ^[6] | R | |
| MFR_POUT_MAX | A7h | R ^[5] | R | |
| BCM_EN_POLARITY | D0h | | R/W | W |
| READ_K_FACTOR | D1h | | R | |
| READ_BCM_ROUT | D4h | | R | |
| SET_ALL_THRESHOLDS | D5h | | R/W | W |
| DISABLE_FAULT | D7h | | R/W | W |

^[1] Returns logical OR of all BCMs OPERATION states

^[2] Returns sum of all BCMs recently measured value

^[3] Returns highest BCM measured value

^[4] Returns highest rated BCM value

^[5] Returns lowest rated BCM value

^[6] Returns sum of all rated connected BCMs value

Page Command (00h)


The page command data byte of 00h prior to a command call will address the Digital Supervisor specific data and a page data byte of FFh would broadcast to all of the connected BCMs. The value of the Data Byte corresponds to the pin name trailing number with the exception of 00h and FFh.

| Data Byte | Description |
|-----------|-------------------------|
| 00h | Digital Supervisor |
| 01h | BCM at TX1 and RX1 |
| 02h | BCM at TX2 and RX2 |
| 03h | BCM at TX3 and RX3 |
| 04h | BCM at TX4 and RX4 |
| FFh | All UART Connected BCMs |

OPERATION Command (01h)


The Operation command and the BCM EN can both be used to turn on and off the connected BCM. Note that the host OPERATION command will not enable the BCM if the BCM EN pin is disabled in hardware with respect to the pre-set pin polarity. Only with the EN pin active, will the OPERATION command provide ON/OFF control.

If synchronous startup is required in the system, it is recommended to use the BCM EN pin in order to achieve simultaneous array startup.

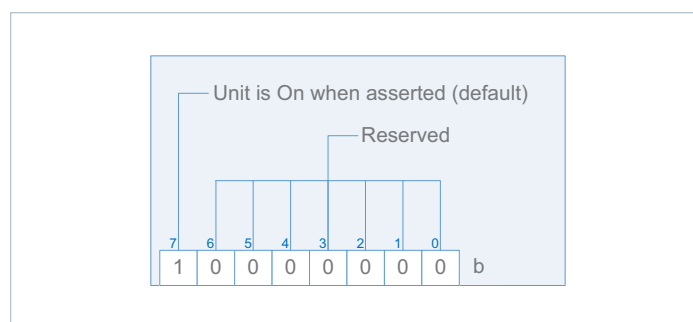

This command accepts only two data values: 00h and 80h. If any other value is sent the command will be rejected and a CML Data error will result.

ON_OFF_CONFIG Command (02h)

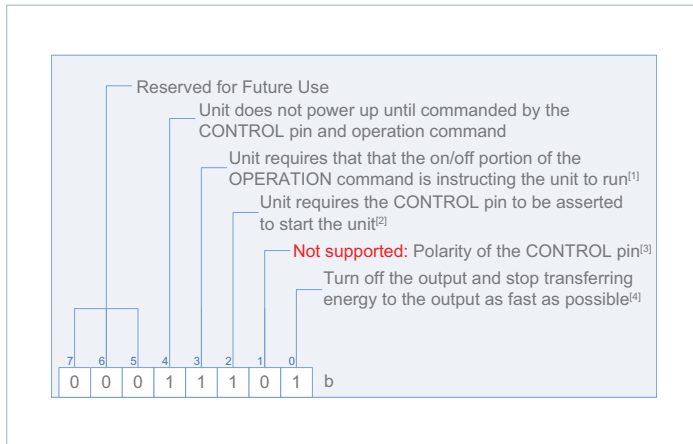

^[1] The BCM Enable pin is ALWAYS to be asserted for powerup. The BCM_EN_POLARITY command (D0h) bit(1) defines the logic level required for the control pin (i.e BCM Enable pin) to be asserted.

^[2] With respect to the BCM EN Control Pin if used in system


^[3] See MFR_SPECIFIC_00 / BCM_EN_POLARITY to change the Polarity of the BCM Enable Pin

^[4] The BCM powertrain once disabled cannot sink current

CLEAR_FAULTS Command (03h)

This command clears all status bits that have been previously set. Persistent or active faults are re-asserted again once cleared. All faults are latched once asserted in the Digital Supervisor. Registered faults will not be cleared when shutting down the BCM powertrain by recycling the BCM input voltage, or toggling the BCM EN pin, or sending the OPERATION command.

CAPABILITY Command (19h)

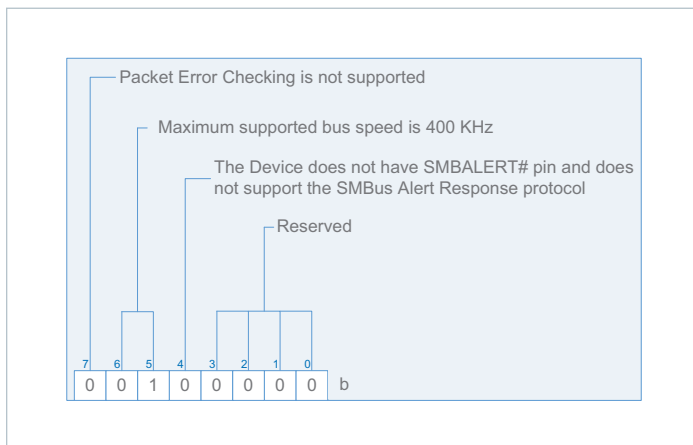

The Digital Supervisor returns a default value of 20h. This value indicates that the PMBus™ frequency supported is up to 400 KHz and that both Packet Error Checking (PEC) and SMBALERT# are not supported.

OT_FAULT_LIMIT Command (4Fh), OT_WARN_LIMIT Command (51h), VIN_OV_FAULT_LIMIT Command (55h), VIN_OV_WARN_LIMIT Command (57h), IIN_OC_FAULT_LIMIT Command (5Bh), IIN_OC_WARN_LIMIT Command (5Dh)

The values of these registers are set in non-volatile memory and can only be written when the BCMs are disabled.

The values of the above mentioned fault and warning are set by default to a 100% of the respective BCM model supervisory limits. However these limits can be set to a lower value. For example: In order for a limit percentage to be set to 80% one would send a write command with a (50h) Data Word.

Any values outside the range of (00h – 64h) sent by a host will be rejected, will not override the currently stored value and will set the Unsupported Data bit in STATUS_CML.

The SET_ALL_THRESHOLDS COMMAND (D5h) combines in one block over temperature fault and warning limits, V_{IN} overvoltage fault and warning limits as well as I_{OUT} overcurrent fault and warning limits. A delay prior to a read command of up to 200 ms following a write of new value is required.

The VIN_UV_WARN_LIMIT (58h) and VIN_UV_FAULT_LIMIT (59h) are set by the factory and cannot be changed by the host. However, a host can disable the under voltage setting using the DISABLE_FAULT COMMAND (D7h).

All FAULT_RESPONSE commands are unsupported. The BCM powertrain supervisory limits and powertrain protection will behave as described in the BCM datasheet. In general, once a fault is detected, the BCM powertrain will shut down and attempt to auto-restart after a predetermined delay.

TON_DELAY Command (60h)


The value of this register word is set in non-volatile memory and can only be written when the BCMs are disabled.

The maximum possible delay is 100ms. Default value is set to (00h). Follow this equation below to interpret the reported value.

$$TON_DELAY_{ACTUAL} = t_{REPORTED} \cdot 10^{-3}(s)$$

Staggering startup in an array is possible with TON_DELAY Command. This delay will be in addition to any startup delay inherent in the BCM module. For example: startup delay from application of V_{IN} is typically 20 ms whereas startup with EN pin is typically 250 us. When TON_DELAY is greater than zero, the set delay will be added to both.

STATUS_BYTE (78h) and STATUS_WORD (79h)

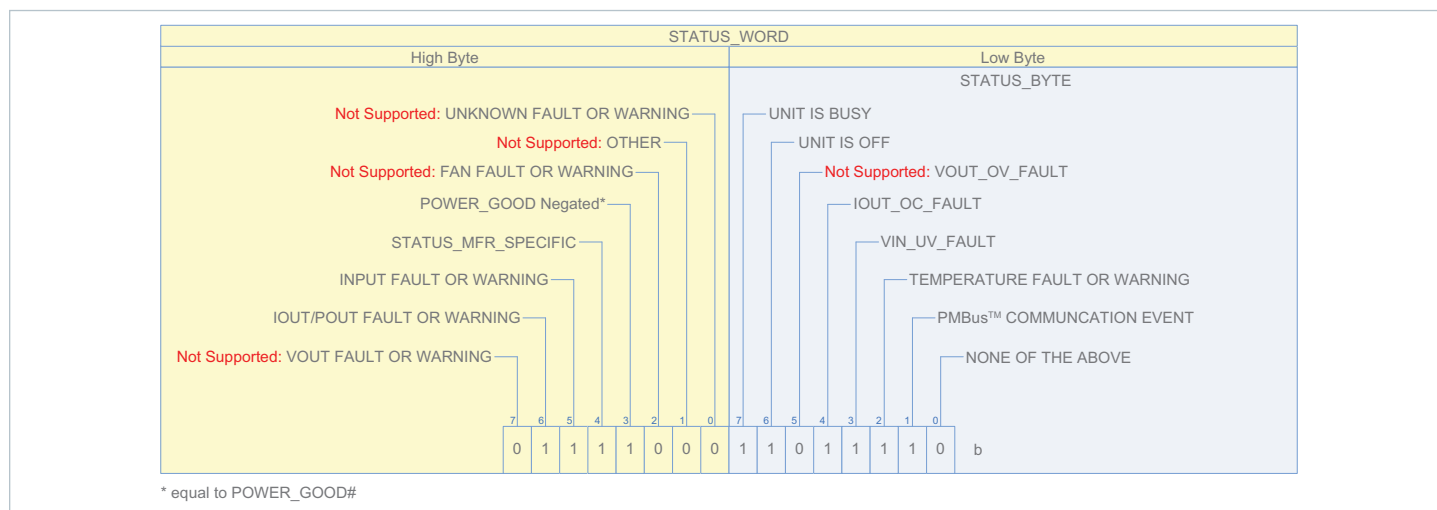

All fault or warning flags, if set, will remain asserted until cleared by the host or once the Digital Supervisor power is removed. This includes under voltage fault, overvoltage fault, overvoltage warning, overcurrent warning, over temperature fault, over temperature warning, under temperature fault, reverse operation, communication faults and analog controller shutdown fault.

Asserted status bits in all status registers, with the exception of STATUS_WORD and STATUS_BYTE, can be individually cleared. This is done by sending a data byte with one in the bit position corresponding to the intended warning or fault to be cleared. Refer to the PMBus™ Power System Management Protocol Specification – Part II – Revision 1.2 for details.

The POWER_GOOD# bit reflects the state of the device and does not reflect the state of the POWER_GOOD# signal limits. The POWER_GOOD_ON COMMAND (5Eh) and POWER_GOOD_OFF COMMAND (5Fh) are not supported. The POWER_GOOD# bit is set anytime the BCM is not in the enabled state, to indicate that the powertrain is inactive and not switching. The POWER_GOOD# bit is cleared when the BCM completes the enabling state, 5 ms after the powertrain is activated allowing for soft-start to elapse. POWER_GOOD# and OFF bits cannot be cleared as they always reflect the current state of the device.

When Page (00h) is used the POWER_GOOD# bit reflects the OR-ing of all active BCMs' POWER_GOOD# bits. When Page (01h – 04h) is used POWER_GOOD# is clear only when the BCM is active.

When Page (00h) is used UNIT IS OFF is SET when all BCMs are not active. When Page (01h – 04h) is used UNIT IS OFF is clear only when the BCM is active.


The Busy bit can be cleared using CLEAR_ALL Command (03h) or by writing either data value (40h, 80h) to PAGE (00h) using the STATUS_BYTE (78h).

Fault reporting, such as SMBALERT# signal output, and host notification by temporarily acquiring bus master status is not supported.

If the Digital Supervisor is still powered, it will retain the last status it received from the BCM and this information will be available to the user via a PMBus Status request. This is in agreement with the PMBus standard which requires that status bits remain set until specifically cleared. Note that in this case where the BCM V_{IN} is lost, the status will always indicate an under voltage fault, in addition to any other fault that occurred.


NONE OF THE ABOVE bit will be asserted if either the STATUS_MFR_SPECIFIC (80h) or the High Byte of the STATUS WORD is set.

STATUS_IOUT (7Bh)

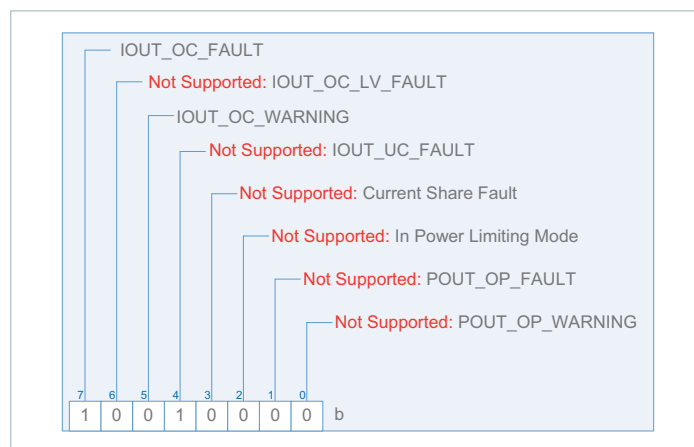


Unsupported bits are indicated above. A one indicates a fault.

STATUS_INPUT (7Ch)

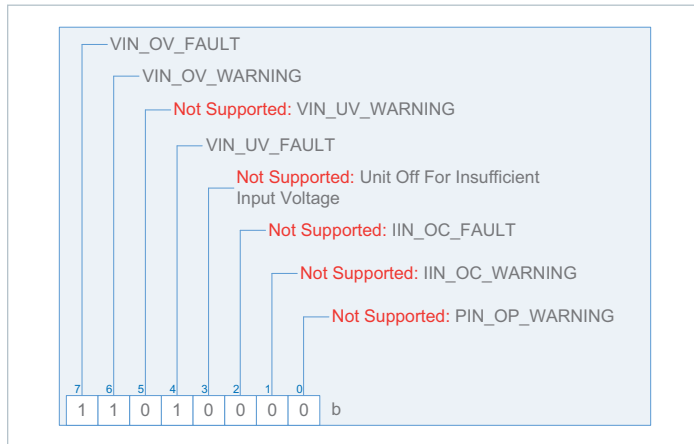


Unsupported bits are indicated above. A one indicates a fault.

STATUS_TEMPERATURE (7Dh)

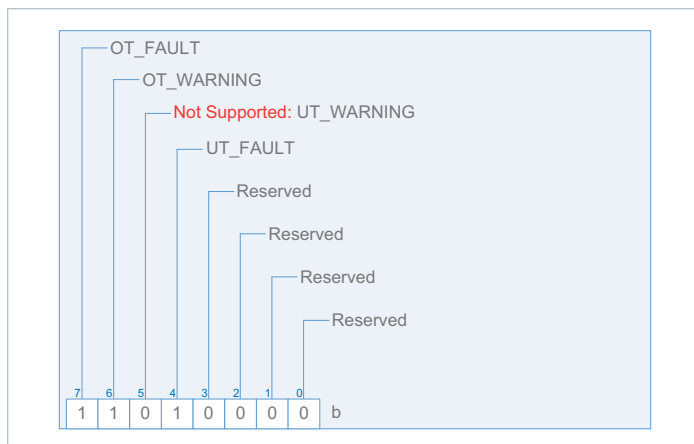

Unsupported bits are indicated above. A one indicates a fault.


STATUS_CML (7Eh)

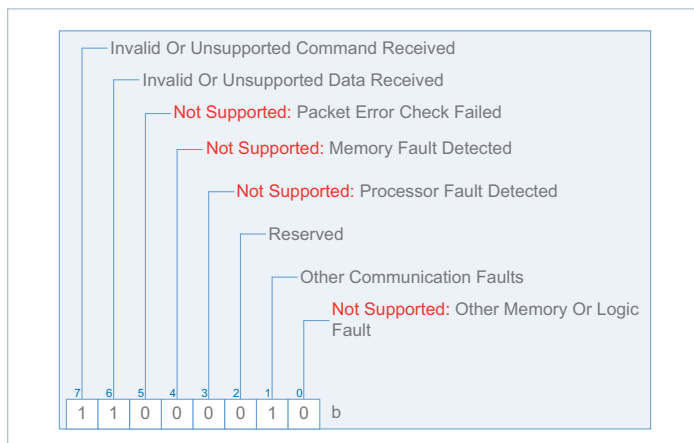

Unsupported bits are indicated above. A one indicates a fault.

The STATUS_CML data byte will be asserted when an unsupported PMBus™ command or data or other communication fault occurred.


STATUS_MFR_SPECIFIC (80h)

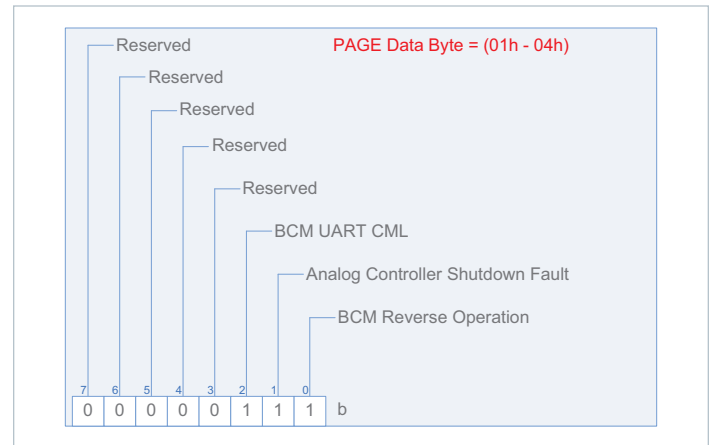

The reverse operation bit, if asserted, indicates that the BCM is processing current in reverse. Reverse current reported value is not supported.

The BCM has analog protections and Digital Supervisory protections. The analog controller provides an additional layer of protection and has the fastest response time. The analog controller shutdown fault, when asserted, indicates that at least one of the powertrain protection faults is triggered. This fault will also be asserted if a disabled fault event occurs after asserting any bit using the DISABLE_FAULTS COMMAND.

The BCM UART is designed to operate with the Digital Supervisor UART. If the BCM UART CML is asserted, it may indicate a hardware or connection issue between both devices.

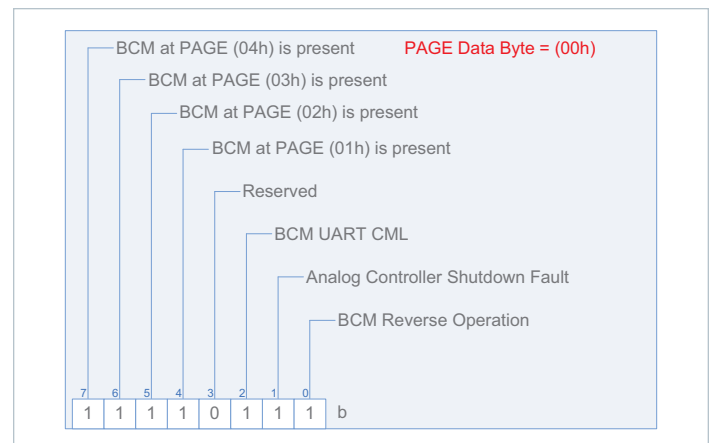

When PAGE COMMAND (00h) data byte is equal to (00h), the the BCM Reverse operation, Analog Controller Shutdown Fault, and BCM UART CML bit will return OR-ing result of active BCMs. The BCM UART CML will also be asserted if any of the active BCMs stops responding. The BCM must communicate at least once to the Digital Supervisor in order to trigger this FAULT. The BCM UART CML can be cleared from the culprit BCM once the Digital Supervisor is able to communicate with it once again or can be cleared using PAGE (00h) CLEAR_FAULTS (03h) Command.

READ_VIN Command (88h)

If PAGE data byte is equal to (01h - 04h) command will return a reported individual BCM's input voltage in the following format:

$$V_{VIN_ACTUAL} = V_{VIN_REPORTED} \cdot 10^{-1}(V)$$

READ_IIN Command (89h)

If PAGE data byte is equal to (01h - 04h) command will return a reported individual BCM's input current in the following format:

$$I_{IIN_ACTUAL} = I_{IIN_REPORTED} \cdot 10^{-3}(A)$$

If PAGE data byte is equal (00h) command will return the sum of active BCMs' input current.

READ_VOUT Command (8Bh)

If PAGE data byte is equal to (01h - 04h) command will return a reported individual BCM's output voltage in the following format:

$$V_{VOUT_ACTUAL} = V_{VOUT_REPORTED} \cdot 10^{-1}(V)$$

READ_IOUT Command (8Ch)

If PAGE data byte is equal to (01h - 04h) command will return a reported individual BCM's output current in the following format:

$$I_{IOUT_ACTUAL} = I_{IOUT_REPORTED} \cdot 10^{-2}(A)$$

If PAGE data byte is equal (00h) command will return the sum of active BCMs' output current.

READ_TEMPERATURE_1 Command (8Dh)

If PAGE data byte is equal to (01h - 04h) command will return a reported individual BCM's temperature in the following format:

$$T_{ACTUAL} = \pm T_{REPORTED} (^{\circ}C)$$

If PAGE data byte is equal (00h) command will return the maximum temperature of active BCMs.

READ_POUT Command (96h)

If PAGE data byte is equal to (01h - 04h) command will return a reported individual BCM's output power in the following format:

$$POUT_{ACTUAL} = POUT_{REPORTED} (W)$$

If PAGE data byte is equal to (00h) command will return the sum of active BCMs' output power.

MFR_VIN_MIN Command (A0h), MFR_VIN_MAX Command (A1h), MFR_VOUT_MIN Command (A4h), MFR_VOUT_MAX Command (A5h), MFR_IOUT_MAX Command (A6h), MFR_POUT_MAX Command (A7h)


These values are set by the factory and indicate the device input output voltage and output current range and output power capacity.

The Digital Supervisor will report rated BCM input voltage minimum and maximum in Volts, output voltage minimum and maximum in Volts, output current maximum in Amperes and output power maximum in Watts.

If PAGE data byte is equal to (00h) then:

- MFR_VIN_MIN COMMAND (A0h) will return the highest MFR_VIN_MIN of all active BCMs
- MFR_VIN_MAX COMMAND (A1h) will return the lowest MFR_VIN_MAX of all active BCMs
- MFR_VOUT_MIN COMMAND (A4h) will return the highest MFR_VOUT_MIN of all active BCMs
- MFR_VOUT_MAX COMMAND (A5h) will return the lowest MFR_VOUT_MAX of all active BCMs
- MFR_IOUT_MAX COMMAND (A6h) will return the SUM of MFR_IOUT_MAX of all active BCMs
- MFR_POUT_MAX COMMAND (A7h) will return the SUM of MFR_POUT_MAX of all active BCMs

BCM_EN_POLARITY Command (D0h)

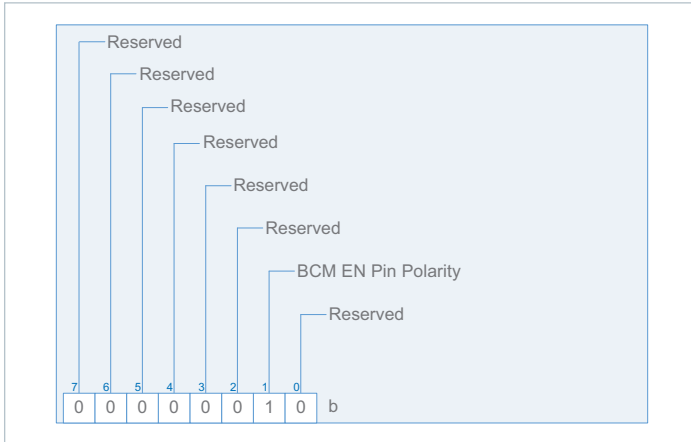

The value of this register is set in non-volatile memory and can only be written when the BCMs are disabled.

When PAGE COMMAND (00h) data byte is equal to (01h – 04h), this command defines the polarity of the EN pin. If BCM_EN_POLARITY is set, the BCM will startup once VIN is greater than the under voltage threshold.

The BCM EN PIN is internally pulled-up to 3.3V. If the BCM_EN_POLARITY is cleared, an external pull-down is then required. Applying VIN greater than the under voltage threshold will not suffice to start the BCM.

READ_K_FACTOR Command (D1h)

If PAGE data byte is equal to (01h - 04h) command will return a reported individual BCM's K factor in the following format:

$$K_FACTOR_{ACTUAL} = K_FACTOR_{REPORTED} \cdot 2^{-16}(V/V)$$


The K factor is defined in a BCM to represent the ratio of the transformer winding and hence is equal to V_{OUT} / V_{IN} .

READ_BCM_ROUT Command (D4h)

If PAGE data byte is equal to (01h - 04h) command will return a reported individual BCM's output resistance in the following format:

$$BCM_ROUT_{ACTUAL} = BCM_ROUT_{REPORTED} \cdot 10^{-5}(\Omega)$$

SET_ALL_THRESHOLDS Command (D5h)

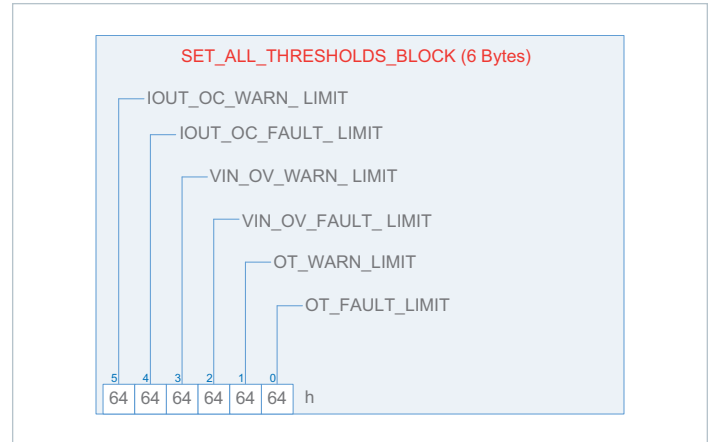


Values of this register block is set in non-volatile memory and can only be written when the BCMs are disabled.

This command provides a convenient way to configure all the limits, or any combination of limits described previously using one command.

Vin Overvoltage, Overcurrent and over-Temperature values are all set to 100% of the BCM datasheet supervisory limits by default and can only be set to a lower percentage.

To leave a particular threshold unchanged, set the corresponding threshold data byte to a value greater than (64h).

DISABLE_FAULT Command (D7h)

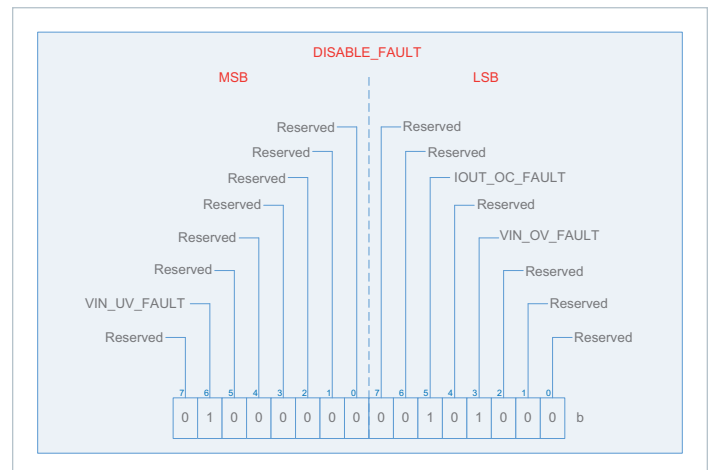

Unsupported bits are indicated above. A one indicates that the supervisory fault associated with the asserted bit is disabled.

The value of these registers is set in non-volatile memory and can only be written when the BCMs are disabled.

This command allows the host to disable the supervisory faults and respective statuses. It does not disable the powertrain analog protections or warnings with respect to the set limits in the SET_ALL_THRESHOLDS Command.

The input under-voltage can only be disabled to a pre-set low limit as shown in the functional reporting range in the BCM data sheet.

The Digital Supervisor Implementation vs. PMBus™ Specification Rev 1.2

The Digital Supervisor is an I²C compliant, SMBus™ compatible device and PMBus command compliant device. This section denotes some deviation, perceived as differences from the PMBus Part I and Part II specification Rev 1.2.

1. The Digital Supervisor meets all Part I and II PMBus specification requirements with the following differences to the transport requirement.

| Unmet DC parameter Implementation vs SMBus™ spec | | | | | | |
|--|-----------------------|----------|------|----------------|---------------------|-------|
| Symbol | Parameter | D44TL1A0 | | SMBus™ Rev 2.0 | | Units |
| | | Min | Max | Min | Max | |
| V _{IL} ^[a] | Input Low Voltage | - | 0.99 | - | 0.8 | V |
| V _{IH} ^[a] | Input High Voltage | 2.31 | - | 2.1 | V _{VDD_IN} | V |
| I _{LEAK_PIN} ^[b] | Input Leakage per Pin | 10 | 22 | - | ±5 | µA |

^[a] V_{VDD_IN} = 3.3 V

^[b] V_{BUS} = 5 V

2. The Digital Supervisor accepts 38 PMBus command codes. Implemented commands execute functions as described in the PMBus specification.

■ Deviations from the PMBus specification:

a. Section 15, fault related commands

- The limits and Warnings unit implemented is percentage (%) a range from decimal (0-100) of the factory set limits.

3. The Digital Supervisor unsupported PMBus command code response as described in the Fault Management and Reporting:

■ Deviations from the PMBus specification:

a. PMBus section 10.2.5.3, exceptions

- The busy bit of the STATUS_BYTE as implemented can be cleared (80h). In order to maintain compatibility with the specification (40h) can also be used.

■ Manufacturer Implementation of the PMBus Spec

a. PMBus section 10.5, setting the response to a detected fault condition

- All powertrain responses are pre-set and cannot be changed. Refer to the BCM datasheet for details.

b. PMBus section 10.6, reporting faults and warnings to the Host

- SMBALERT# signal and Direct PMBus Device to Host Communication are not supported. However, the Digital Supervisor will set the corresponding fault status bits and will wait for the host to poll.

c. PMBus section 10.7, clearing a shutdown due to a fault

- There is no RESET pin or EN pin in the Digital Supervisor. Cycling power to the Digital Supervisor will not clear a BCM Shutdown. The BCM will clear itself once the fault condition is removed. Refer to the BCM datasheet for details.

d. PMBus Section 10.8.1, corrupted data transmission faults:

- Packet error checking is not supported.

Data Transmission Faults Implementation

This section describes data transmission faults as implemented in the Digital Supervisor.

| Section | Description | Response to Host | | STATUS_BYTE | STATUS_CML | | Notes |
|---------|-----------------------------------|------------------|-----|-------------|-------------|------------------|--|
| | | NAK | FFh | CML | Other Fault | Unsupported Data | |
| 10.8.1 | Corrupted data | | | | | | No response; PEC not supported |
| 10.8.2 | Sending too few bits | | | X | X | | |
| 10.8.3 | Reading too few bits | | | X | X | | |
| 10.8.4 | Host sends or reads too few bytes | | | X | X | | |
| 10.8.5 | Host sends too many bytes | X | | X | | X | |
| 10.8.6 | Reading too many bytes | | X | X | X | | |
| 10.8.7 | Device busy | X | X | | | | Device will ACK own address BUSY bit in STATUS_BYTE even if STATUS_WORD is set |

Data Content Faults Implementation

This section describes data content fault as implemented in the Digital Supervisor.


| Section | Description | Response to Host | STATUS_BYTE | STATUS_CML | | | Notes |
|---------|---|------------------|-------------|-------------|---------------------|------------------|--------------------------|
| | | NAK | CML | Other Fault | Unsupported Command | Unsupported Data | |
| 10.9.1 | Improperly Set Read Bit In The Address Byte | X | X | X | | | |
| 10.9.2 | Unsupported Command Code | X | X | | X | | |
| 10.9.3 | Invalid or Unsupported Data | | X | | | X | |
| 10.9.4 | Data Out of Range | | X | | | X | |
| 10.9.5 | Reserved Bits | | | | | | No response; not a fault |

Layout Considerations

Application Note AN:016 details board layout recommendations using VI Chip® modules to attain the design goals of good power connections, reducing EMI, and shielding of control signals.

The Digital Supervisor signal should be properly shielded from external noise sources, including the BCM itself. The preferred method is to route (RX, TX) signals in internal layers and to envelop both signals with continuous reference planes referenced to –OUT of the respective BCM. These digital signals can have fast edges. Standard digital design practices should be used.

Avoid routing BCM signals ENABLE, SER-IN and SER-OUT directly underneath the BCM.



Vicor's comprehensive line of power solutions includes high density AC-DC and DC-DC modules and accessory components, fully configurable AC-DC and DC-DC power supplies, and complete custom power systems.

Information furnished by Vicor is believed to be accurate and reliable. However, no responsibility is assumed by Vicor for its use. Vicor makes no representations or warranties with respect to the accuracy or completeness of the contents of this publication. Vicor reserves the right to make changes to any products, specifications, and product descriptions at any time without notice. Information published by Vicor has been checked and is believed to be accurate at the time it was printed; however, Vicor assumes no responsibility for inaccuracies. Testing and other quality controls are used to the extent Vicor deems necessary to support Vicor's product warranty. Except where mandated by government requirements, testing of all parameters of each product is not necessarily performed.

Specifications are subject to change without notice.

Vicor's Standard Terms and Conditions

All sales are subject to Vicor's Standard Terms and Conditions of Sale, which are available on Vicor's webpage or upon request.

Product Warranty

In Vicor's standard terms and conditions of sale, Vicor warrants that its products are free from non-conformity to its Standard Specifications (the "Express Limited Warranty"). This warranty is extended only to the original Buyer for the period expiring two (2) years after the date of shipment and is not transferable.

UNLESS OTHERWISE EXPRESSLY STATED IN A WRITTEN SALES AGREEMENT SIGNED BY A DULY AUTHORIZED VICOR SIGNATORY, VICOR DISCLAIMS ALL REPRESENTATIONS, LIABILITIES, AND WARRANTIES OF ANY KIND (WHETHER ARISING BY IMPLICATION OR BY OPERATION OF LAW) WITH RESPECT TO THE PRODUCTS, INCLUDING, WITHOUT LIMITATION, ANY WARRANTIES OR REPRESENTATIONS AS TO MERCHANTABILITY, FITNESS FOR PARTICULAR PURPOSE, INFRINGEMENT OF ANY PATENT, COPYRIGHT, OR OTHER INTELLECTUAL PROPERTY RIGHT, OR ANY OTHER MATTER.

This warranty does not extend to products subjected to misuse, accident, or improper application, maintenance, or storage. Vicor shall not be liable for collateral or consequential damage. Vicor disclaims any and all liability arising out of the application or use of any product or circuit and assumes no liability for applications assistance or buyer product design. Buyers are responsible for their products and applications using Vicor products and components. Prior to using or distributing any products that include Vicor components, buyers should provide adequate design, testing and operating safeguards.

Vicor will repair or replace defective products in accordance with its own best judgment. For service under this warranty, the buyer must contact Vicor to obtain a Return Material Authorization (RMA) number and shipping instructions. Products returned without prior authorization will be returned to the buyer. The buyer will pay all charges incurred in returning the product to the factory. Vicor will pay all reshipment charges if the product was defective within the terms of this warranty.

Life Support Policy

VICOR'S PRODUCTS ARE NOT AUTHORIZED FOR USE AS CRITICAL COMPONENTS IN LIFE SUPPORT DEVICES OR SYSTEMS WITHOUT THE EXPRESS PRIOR WRITTEN APPROVAL OF THE CHIEF EXECUTIVE OFFICER AND GENERAL COUNSEL OF VICOR CORPORATION. As used herein, life support devices or systems are devices which (a) are intended for surgical implant into the body, or (b) support or sustain life and whose failure to perform when properly used in accordance with instructions for use provided in the labeling can be reasonably expected to result in a significant injury to the user. A critical component is any component in a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system or to affect its safety or effectiveness. Per Vicor Terms and Conditions of Sale, the user of Vicor products and components in life support applications assumes all risks of such use and indemnifies Vicor against all liability and damages.

Intellectual Property Notice

Vicor and its subsidiaries own Intellectual Property relating to the products described in this data sheet. No license, whether express, implied, or arising by estoppel or otherwise, to any intellectual property rights is granted by this document. Interested parties should contact Vicor's Intellectual Property Department.

Vicor Corporation

25 Frontage Road
Andover, MA, USA 01810
Tel: 800-735-6200
Fax: 978-475-6715

email

Customer Service: custserv@vicorpower.com
Technical Support: apps@vicorpower.com




Компания «ЭлектроПласт» предлагает заключение долгосрочных отношений при поставках импортных электронных компонентов на взаимовыгодных условиях!

Наши преимущества:

- Оперативные поставки широкого спектра электронных компонентов отечественного и импортного производства напрямую от производителей и с крупнейших мировых складов;
- Поставка более 17-ти миллионов наименований электронных компонентов;
- Поставка сложных, дефицитных, либо снятых с производства позиций;
- Оперативные сроки поставки под заказ (от 5 рабочих дней);
- Экспресс доставка в любую точку России;
- Техническая поддержка проекта, помощь в подборе аналогов, поставка прототипов;
- Система менеджмента качества сертифицирована по Международному стандарту ISO 9001;
- Лицензия ФСБ на осуществление работ с использованием сведений, составляющих государственную тайну;
- Поставка специализированных компонентов (Xilinx, Altera, Analog Devices, Intersil, Interpoint, Microsemi, Aeroflex, Peregrine, Syfer, Eurofarad, Texas Instrument, Miteq, Cobham, E2V, MA-COM, Hittite, Mini-Circuits, General Dynamics и др.);

Помимо этого, одним из направлений компании «ЭлектроПласт» является направление «Источники питания». Мы предлагаем Вам помощь Конструкторского отдела:

- Подбор оптимального решения, техническое обоснование при выборе компонента;
- Подбор аналогов;
- Консультации по применению компонента;
- Поставка образцов и прототипов;
- Техническая поддержка проекта;
- Защита от снятия компонента с производства.

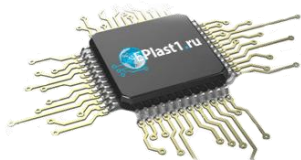

Как с нами связаться

Телефон: 8 (812) 309 58 32 (многоканальный)

Факс: 8 (812) 320-02-42

Электронная почта: org@eplast1.ru

Адрес: 198099, г. Санкт-Петербург, ул. Калинина, дом 2, корпус 4, литера А.