

QUICK START GUIDE FOR DEMONSTRATION CIRCUIT 448

DUAL OUTPUT ISOLATED POWER SUPPLY

LT3710

DESCRIPTION

Demonstration circuit 448 is a dual output high efficiency isolated DC/DC power supply with 36V to 72V input range. It has two outputs: 3.3V at 10A max and 1.8V or 2.5V at 10A max. LT3710, a secondary side synchronous post regulator controller, is used to generate a tightly regulated second output directly from the transformer secondary winding, thus minimizing the size of

the output inductor and capacitor at the first output stage. Synchronous MOSFETs significantly improve efficiency, making it suitable for low output voltage applications. The complete design is mounted within a standard half brick PCB area with about half inch height.

Design files for this circuit board are available. Call the LTC factory.

Table 1. Performance Summary ($T_A = 25^\circ\text{C}$)

PARAMETER	CONDITION	VALUE
Minimum Input Voltage		36V
Maximum Input Voltage		72V
V_{OUT1}	$V_{IN} = 36\text{V to } 72\text{V}$, $I_{OUT1} = 0\text{A to } 10\text{A}$, $I_{OUT2} = 0\text{A to } 10\text{A}$	$3.3\text{V} \pm 2\%$
V_{OUT2}	$V_{IN} = 36\text{V to } 72\text{V}$, $I_{OUT1} = 0\text{A to } 10\text{A}$, $I_{OUT2} = 0\text{A to } 10\text{A}$	$1.83\text{V} \pm 2\%$ (JP1, JP2: 1.8V position) or $2.53\text{V} \pm 2\%$ (JP1, JP2: 2.5V position)
Typical Output Ripple V_{OUT1}	$V_{IN} = 48\text{V}$, $I_{OUT1} = 10\text{A}$ (20MHz BW)	70mV _{p-p}
Typical Output Ripple V_{OUT2}	$V_{IN} = 48\text{V}$, $I_{OUT2} = 10\text{A}$ (20MHz BW)	50mV _{p-p} for 1.8Vo 60mV _{p-p} for 2.5Vo
Output Regulation	Line Load	$\pm 0.1\%$ $\pm 0.2\%$
Nominal Switching Frequency		230kHz
Efficiency	$V_{IN} = 48\text{V}$, $V_{OUT1} = 3.3\text{V}$, $V_{OUT2} = 1.8\text{V}$, $I_{OUT1} = I_{OUT2} = 10\text{A}$ $V_{IN} = 48\text{V}$, $V_{OUT1} = 3.3\text{V}$, $V_{OUT2} = 2.5\text{V}$, $I_{OUT1} = I_{OUT2} = 10\text{A}$	86% Typical 87% Typical
Output Voltage V_{OUT1} Trim	$V_{O1\text{ TRIM}} = 3.3\text{V}$ $V_{O1\text{ TRIM}} = 0\text{V}$	5% Typical -5% Typical
On/Off Control	Logic Low Voltage-Off Logic High Voltage-On	0.6V Max 1V Min
Isolation Voltage	Basic Insulation	1500VDC

OPERATING PRINCIPLES

Demonstration circuit 448A features the LT3710, LT3781 and LTC1698 controllers. The basic power stage topology is a two-switch forward converter with synchronous rectification. The primary side controller uses the LT3781, a current mode two-switch forward controller with built-in MOSFET drivers. On the secondary side, an LTC1698 is used to provide the voltage feedback for the 3.3V output, as well as the gate drive for the synchronous MOSFETs in the 3.3V output stage. The error amplifier output of the 3.3V circuit is fed into the optocoupler and then relayed to LT3781 on the primary side to complete the 3.3V regulation. The second 1.8V/2.5V output is directly regulated by the LT3710 circuit.

A planar transformer PA0191 built by Pulse Engineering is employed as the power transformer in this design. This transformer is constructed on a PQ20 core with nine turns of primary windings, two turns of secondary

windings and seven turns of auxiliary windings for the LT3781 bias supply. A Vishay Si7892DP is used due to its low $R_{DS(ON)}$, 30V V_{DSS} rating and its compact and thermally enhanced PowerPak SO-8 package.

The switching frequency of the circuit is about 230KHz. 1500V input to output isolation is provided. Additional features of this demo board include primary side on/off control, $\pm 5\%$ secondary side trimming on the 3.3V output, input overvoltage protection, under voltage lockout, 3.3V output overvoltage protection, 1.8V/2.5V output current limit and board overtemperature shutdown.

The demo board can deliver the full rated currents (10A at both outputs) at room temperature without airflow. The hottest spot on the demo board (T1 transformer) has a temperature rise of 50°C at 48V input and full loads (without airflow).

QUICK START PROCEDURE

Demonstration circuit DC448 is easy to set up to evaluate the performance of the LT3710, LT3781 and LTC1698. Refer to Figure 1 for proper measurement equipment setup and follow the procedure below:

NOTE: When measuring the input or output voltage ripple, care must be taken to avoid a long ground lead on the oscilloscope probe. Measure the input or output voltage ripple by touching the probe tip directly across the V_{in} or V_{out} and GND terminals. See Figure 2 for proper scope probe technique.

Default jumper setting: both jumpers at 1.8V position

1. Select V_{out2} 1.8V (or 2.5V): Place both jumpers JP1 and JP2 at 1.8V (or 2.5V) position.
2. With power off, connect the input power supply to $+V_{in}$ (36V–72V) and $-V_{in}$ (input return).

3. The on/off control pin should be left open for normal operation. (Connecting the on/off pin to the $-V_{in}$ turns off the converter.)
4. For normal 3.3V output, V_{o1} Trim pin should be left open.
5. Connect the 3.3V load (Load 1 in Figure 1) between $+V_{o1}$ and V_{o} RTN; connect the 1.8V/2.5V load (Load 2 in Figure 1) between $+V_{o2}$ and V_{o} RTN.
6. Connect the DVMs to the input and outputs.
7. Turn on the input power supply and check for the proper output voltages. V_{o1} should be 3.3V $\pm 2\%$. V_{o2} should be 1.83V $\pm 2\%$ if 1.8V V_{o} is selected (or V_{o2} should be 2.53V $\pm 2\%$ if 2.5V V_{o} is selected).

QUICK START GUIDE FOR DEMONSTRATION CIRCUIT 448

DUAL OUTPUT ISOLATED POWER SUPPLY

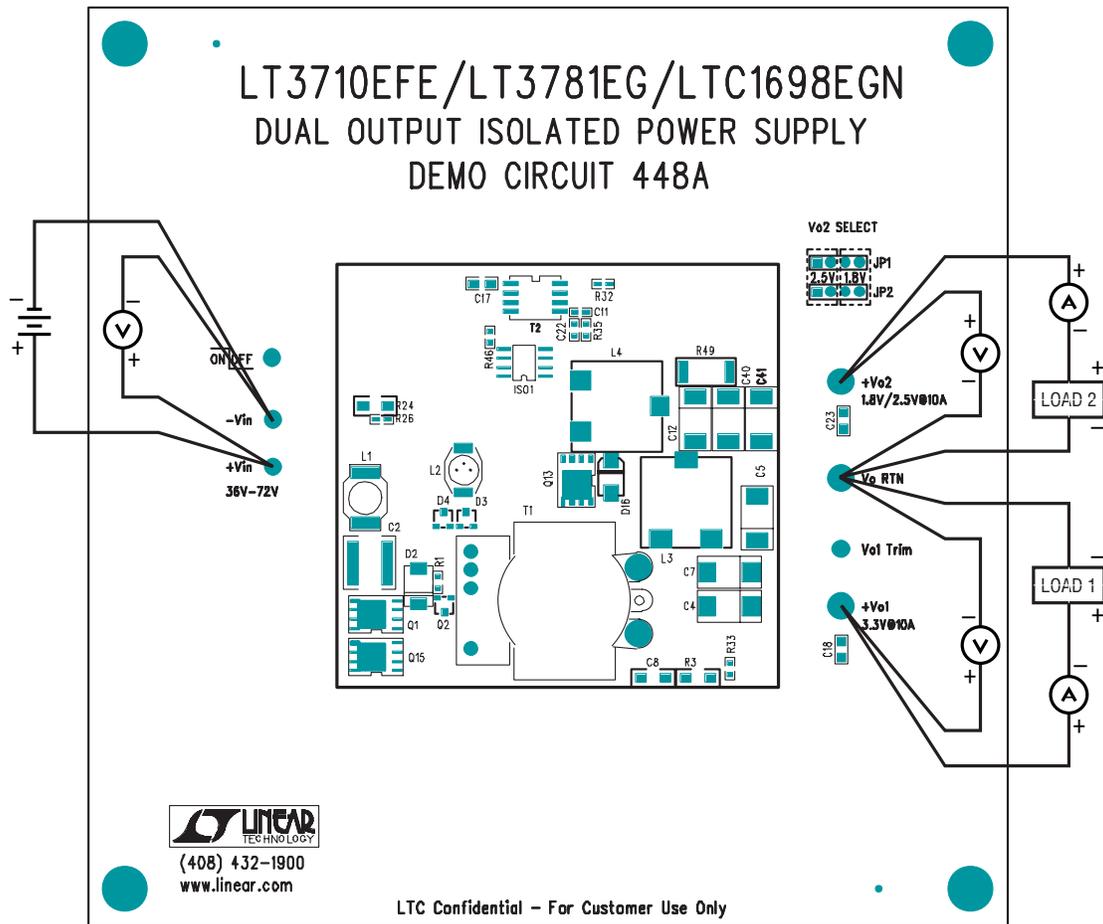


Figure 1. Proper Measurement Equipment Setup




Figure 2. Measuring Input or Output Ripple

QUICK START GUIDE FOR DEMONSTRATION CIRCUIT 448

DUAL OUTPUT ISOLATED POWER SUPPLY

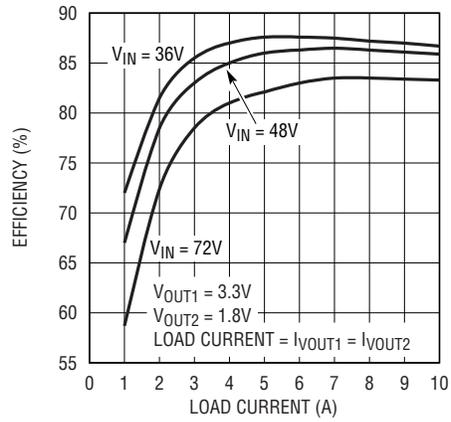


Figure 3. Efficiency vs load current: $V_{out1}=3.3V$ and $V_{out2}=1.8V$

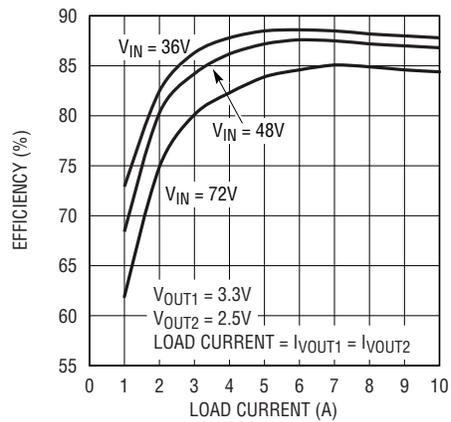


Figure 4. Efficiency vs load current: $V_{out1}=3.3V$ and $V_{out2}=2.5V$



Компания «ЭлектроПласт» предлагает заключение долгосрочных отношений при поставках импортных электронных компонентов на взаимовыгодных условиях!

Наши преимущества:

- Оперативные поставки широкого спектра электронных компонентов отечественного и импортного производства напрямую от производителей и с крупнейших мировых складов;
- Поставка более 17-ти миллионов наименований электронных компонентов;
- Поставка сложных, дефицитных, либо снятых с производства позиций;
- Оперативные сроки поставки под заказ (от 5 рабочих дней);
- Экспресс доставка в любую точку России;
- Техническая поддержка проекта, помощь в подборе аналогов, поставка прототипов;
- Система менеджмента качества сертифицирована по Международному стандарту ISO 9001;
- Лицензия ФСБ на осуществление работ с использованием сведений, составляющих государственную тайну;
- Поставка специализированных компонентов (Xilinx, Altera, Analog Devices, Intersil, Interpoint, Microsemi, Aeroflex, Peregrine, Syfer, Eurofarad, Texas Instrument, Miteq, Cobham, E2V, MA-COM, Hittite, Mini-Circuits, General Dynamics и др.);

Помимо этого, одним из направлений компании «ЭлектроПласт» является направление «Источники питания». Мы предлагаем Вам помощь Конструкторского отдела:

- Подбор оптимального решения, техническое обоснование при выборе компонента;
- Подбор аналогов;
- Консультации по применению компонента;
- Поставка образцов и прототипов;
- Техническая поддержка проекта;
- Защита от снятия компонента с производства.



Как с нами связаться

Телефон: 8 (812) 309 58 32 (многоканальный)

Факс: 8 (812) 320-02-42

Электронная почта: org@eplast1.ru

Адрес: 198099, г. Санкт-Петербург, ул. Калинина, дом 2, корпус 4, литера А.